

Campbell County Fiscal Court 1098 Monmouth Street, Newport, KY 41071

Invitation to Bid

I. <u>Bid Information</u>

Α.	Bid Request:	Cement Block Work - AJ Jolly Park Shelter with Bathroom Structure
В.	Bid Posted:	May 29, 2025
C.	Department:	Park
D.	Bid opening:	June 10, 2025 - 1:00 PM
E.	Location of Open:	Campbell County Administration Building, Fiscal Court Chambers, 1 st Floor, 1098 Monmouth Street, Newport, KY 41071
F.	Bidder Information:	
	Bidders Name	
	Signature	
	Firm/Company	
	Firm/Co. Address	
	Firm/Co. Phone	
	Firm/Co. Email	

II. Instructions to Bidders – Terms and Conditions

The Campbell County Fiscal Court will accept bids for Cement Block Work - AJ Jolly Park Shelter with Bathroom Structure until the above-mentioned time and date.

A. Authority

- 1. This Invitation for Bids is issued in accordance with applicable provisions of the Campbell County Administrative Code Chapter 4 Purchasing and Contracts.
- 2. This is not an order. Please read all instructions, terms, and conditions carefully.

B. Transmission

- 1. Bids should be submitted in a sealed envelope addressed to Campbell County Finance, 1098 Monmouth Street, Suite 322, Newport, KY 41071.
- 2. The envelope must be clearly marked with the bid title.

- 3. Bids will be received at the CCFC Finance department via mail or package delivery to the reception desk on the first floor until the date specified. Late bids, those not clearly marked, or those that do not follow the instructions will not be accepted.
- 4. Campbell County Fiscal Court will not be held responsible for any premature opening or failure to open any bid not properly addressed and identified as stated above.

C. Instructions

- 1. Bid forms must be signed in blue ink with no corrective fluid or materials used.
- 2. One original and one copy of the bid must be submitted. Keep a copy of the bid for your records.
- 3. A list of qualifications and a minimum of three reference are required. Please refer to Section IX.
- 4. Bidders should verify their bids before submission. Errors in preparing the submission confers no right of withdrawal or modification after open.
- 5. Bidders are responsible for all costs associated with the preparation of response to the invitation for bids. Campbell County is not liable for any costs incurred by bidders in their response to this request.
- 6. A pre-bid or pre-award visit to bidder may be required at the discretion of the Owner.

D. Pricing

- 1. Firm prices are required.
- 2. All prices quoted must be F.O.B. destination shown in shipping instructions on specification.
- 3. Insert time discounts, if any. Time discounts will not be a factor in award determination.
- 4. Quotations must be submitted on the bid price sheet indicating unit price, total extension of each item, and grand total of bid.
- 5. Unit prices should be based on the bid specification instructions. Please direct questions to the County at 859-547-1827 prior to submitting a bid.
- 6. Trade discounts must be deducted by the vendor in calculating the unit price. The unit price must be net.
- 7. CCFC is sales and use tax exempt.

E. Warranty

The selected Bidder shall provide warranty on any services and materials found to be defective or faulty due to imperfect or bad workmanship/materials within one year from the date of completion at no additional cost to the County. This warranty does not change or void any warranties expressed or implied to which the purchase is subject.

F. Regulatory Compliance

- Pursuant to the provisions of KRS 45A.343, the contractor or vendor is required to reveal to Campbell County Fiscal Court any final determination of a violation of KRS Chapters 136, 139, 141, 337, 338 and 342 by the contractor or vendor within the previous five (5) years; and further that said contractor or vendor has been and is in continuous compliance with the provisions of KRS Chapters 136, 139, 141, 337, 341, and 342 for the duration of the contract. The failure of a contractor or vendor to reveal a final determination of a violation to a local government, or to comply with the statutory requirements, is considered grounds for cancellation of a contract and disqualification of the contractor or vendor from eligibility for any Campbell County Fiscal Court contracts for a period of two (2) years.
- 2. All bidders must possess all federal, state, and local qualifications licenses to provide products or services in Campbell County, the Commonwealth of Kentucky, and the United States. *Please note: Insurance requirements in Section III, Item J of the bid specifications must be met by the awarded bidder.*

- a. Including, but not limited to
 - i. Business license issued by the Occupational License Department of Campbell County (see County website for application)
 - ii. Hazardous Communication Program (OSHA)
 - iii. Workers' Compensation Certificate
 - iv. Liability Insurance
- Successful bidder shall comply with the Kentucky Human Rights Act, HRA 344.150-344.270 as amended and any rules and regulations promulgated therewith, including, but not limited to the Equal Employment Opportunity EEO 45.550 – 45.640 which is incorporated herein by reference. Furthermore, the successful bidder shall comply with the Employment Discrimination Act, EDA 344.040, 344.050 as amended.

Per Title VI of the Civil Rights Act of 1964, no person in the United States shall, on the grounds of race, color, or national origin, be excluded from participation in, be denied the benefits of, or be otherwise be subjected to discrimination under any program or activity for which a project, contractor/vendor or the county may receive federal financial assistance.

4. The scoring of this bid is subject to reciprocal preference for Kentucky resident bidders. Bidders not claiming resident bidder status need not submit the corresponding affidavit.

G. Bonds

1. Bid bonds, performance bonds, and payment bonds as prescribed by KRS 45A.430, 435, 440 are required for any bids/proposals that exceed \$99,999. Each bid, or the combination of submitted bids, over \$99,999 must be accompanied by a 5% bid bond of the grand total of the bid. The bid bond of the successful bidder will be retained until a performance bond has been executed and approved, after which the bid bond will be returned. The successful bidder will be required to post a performance bond in the amount of 100% of the bid if awarded a contract over \$99,999. Bonding and surety requirements may vary by project/commodity. Please contact Owner for more information.

H. Reserved Rights

- Campbell County Fiscal Court reserves the right to reject any or all bids, including without limitations the right to reject any or all nonconforming, non-responsive, incomplete, unbalanced, or conditional bids, to waive formalities, and to reject the bid of any Bidder if CCFC believes that it would not be in the best interest of Campbell County Fiscal Court to make an award to that Bidder. CCFC also reserves the right to negotiate with the apparent qualified Bidder to such an extent as may be determined by Campbell County Fiscal Court.
- 2. CCFC reserves the right of renewal for any service and maintenance contracts that may be needed for a minimum of two (2) one (1) year periods.
- 3. In the event the successful bidder fails to commence substantial work on the project within thirty (30) days and the County does not waive this requirement, the County shall have the option to reject the bid and to void the contract, and in such event to either accept the next lowest and best bidder or to negotiate with the best qualified bidder
- 4. In the event the successful bidder fails to complete the project by the completion date and the County has not waived this requirement in writing, the County shall receive from the bidder (or withhold from the bidder, at its option) liquidated damages of 3% of total bid per project per calendar day.
- 5. All the terms and conditions of these instructions to bidders and the specifications for this project shall constitute, the part of, and incorporate into, the contract between the County and the successful bidder.

I. Award

It is the intent of Campbell County Fiscal Court to award a contract to the lowest responsible bidder meeting specifications. CCFC reserves the right to determine the lowest responsible bid/offer in any way determined to be in the best interests of Campbell County. Award will be based on the following factors (where applicable): (a) adherence to all conditions and requirements of the bid/proposal specifications; (b) price; (c) qualifications of the bidder, including past performance, financial responsibility, general reputation, experience, service capabilities, and facilities; (d) delivery or completion date; (e) product appearance, workmanship, finish, taste, feel, overall quality, and results of product testing; (f) maintenance costs and warranty provisions; and (g) repurchase or residual value.

III. <u>General Conditions</u>

A. Specifications

No deviation from these specifications will be permitted except upon written permission from the Owner. The Owner is to be the final judge as to the interpretation of the specifications.

B. Workmanship and Materials

All materials unless otherwise specified shall be new. Materials and workmanship shall be of good quality. The work of construction shall be carried out in a substantial manner, subject to the monitoring by the Campbell County Fiscal Court, hereinafter "CCFC".

C. Additions or Omissions

CCFC reserves the right to make alterations, additions to or omissions from the specifications. Should CCFC require additional work, an addendum outlining the scope of work will be submitted to the Contractor who may provide a written schedule of extra cost. CCFC may accept or reject the addendum proposal. An accepted addendum shall not be considered as a waiver of any condition of the contract nor invalidate any of the provisions nor be a release of the performance bond. No allowance will be made for extra work not authorized by CCFC. All work or materials shown on the plans and not mentioned in the Bid Documents, or any work mentioned in the Bid Documents and not shown on the plans, shall be furnished, performed and completed by the Contractor as if the same were mentioned both in the Bid Documents and shown on the plans.

D. Supervision and Equipment

The Contractor, in addition to his own personal supervision, shall keep constantly employed on the work, a thoroughly competent foreman. The Contractor shall furnish adequate tools and mechanical equipment necessary for the proper execution of the work to be performed.

E. Order of Work

The Contractor shall proceed with the various items of work in such a manner that other items of work will not be endangered. The Contractor shall, after starting work, carry the work quickly to completion.

F. Loss of Accident

The Contractor shall assume all risks and bear any loss occasioned by neglect, accident or other cause until work is complete and accepted by the CCFC. The Contractor shall maintain all necessary barriers and lights for the protection of the public and for the protection of the work. The Contractor will be held responsible for damage to adjoining property.

The Contractor shall indemnify and save harmless CCFC and duly authorized agents from any and all claims and all loss or damage suits, judgments, fines or sums of money accruing or claimed to accrue, to any person, corporation, municipality, firm or company against the property or any violation of laws or

regulations, howsoever resulting, growing out of or claimed to grow out of, any act or omission of, or method pursued, or hazard encountered by the Contractor including his agents, servants or employees in or about the work herein undertaken to be done by the Contractor. The Contractor must further save harmless CCFC against any and all claims or liens placed against said work by any laborer, material supplier or finisher.

G. Approval

CCFC shall approve all workmanship and material before the work is considered complete.

H. Removal of Excess Soil, Rubbish and Equipment

The Contractor shall upon completion remove all excess soil, rubbish, debris and equipment from the premises and leave said premises in a neat and clean condition.

I. Payments

Payment shall be made within thirty (30) days after completion and final acceptance of the work by the CCFC. No payment shall be made for any unauthorized work.

J. Insurance

Contractor shall submit a "Certificate of Insurance" showing proof of Kentucky's Workmen's Compensation Insurance and Liability insurance of not less than \$500,000.00 prior to the County issuing a Purchase Order for the project.

K. Contract

The successful bidder may be required to enter into a contract for the work with the Campbell County Fiscal Court.

IV. <u>Special Conditions</u>

A. Scope of Work

The work to be performed under this contract consists of furnishing all materials, equipment, supplies, labor and transportation, including fuel, power, and water, and performing all work as required in Item E, Statement of Work, of this section.

B. Site Visit

Prior to beginning any work on the project, the Contractor is recommended to schedule and have a site visit with representatives of CCFC. Contact Mike Braun at 859-743-4145 to schedule the site visit.

C. Existing Utilities

Before proceeding with the work, the Contractor shall confer with all public or private companies, agencies, or departments that own and operate utilities in the vicinity of the construction work. The purpose of this conference, or conferences, shall be to notify said companies, agencies, or departments of the proposed construction schedule, verify the location of the possible interference with the existing utilities, arrange for necessary suspensions of service and make arrangements to locate and avoid interference with all other utilities. CCFC has no objection to the Contractor arranging for the said utility companies, agencies, or departments to locate and uncover their own utilities; however, insofar as CCFC is concerned, the Contractor shall bear the entire responsibility and expense for locating and avoiding or repairing damage to said existing utilities.

Where existing utilities or other underground structures are encountered, they shall not be displaced or molested unless necessary, and in such case they shall be replaced in as good or better condition than found as quickly as possible. All such utilities that are so damaged or molested shall be replaced at the

Contractor's expense, unless in the opinion of CCFC, such damage was caused through no fault of the Contractor.

It is expected that the Contractor will be diligent in his/her efforts and use every possible means to locate existing utilities. Any claims for unavoidable damage, based on improper or unknown locations, will be thoroughly examined in the light of the Contractor's efforts to locate the utilities or obstructions prior to beginning construction.

D. Statement of Work

The following items are to be completed under this contract. The summation of these items is for the contractor to act as subcontractor to CCFC staff (general contractor). Cement block work and installation will be required at the new shelter and two new restrooms after CCFC staff performs concrete and carpentry work. The selected sequence should be such that no task detracts from or damages a previous task, or prohibits the proper completion of a subsequent task. Plans and drawings for project are attached.

Work location in this contract is as follows: 1501 Racetrack Rd., Alexandria, KY 4101

V. <u>Bid Specifications</u>

- **A.** General scope of work is as defined above under Section IV. E: Statement of Work.
- **B.** Block work drawings from Emboss dated 3/13/2025.
- **C.** All supplies and materials by cement block sub-contractor.
- **D.** Door frames supplied by CCFC installed by block contractor.
- E. CCFC is the G.C.

VI. Bid Sheet

VII. Authentication of Bid and Affidavit of Non-collusion and Non-conflict of Interest

I hereby swear (or affirm) under the penalty for false swearing as provided by KRS 432.170: That I am the bidder (if the bidder is an individual, a partner (if the bidder is a partnership) or an officer or employee of the bidding corporation having authority to sign on its behalf (if the bidder is a corporation);

That the attached bid or bids covering Campbell County Fiscal Court, has been arrived at by the bidder independently and have been submitted without collusion with, and without any agreement, understanding or planned common course of action with any other vendor or materials, supplies, equipment or services described in the invitation to bid, designed to limit independent bidding or competition;

That the contents of the bid or bids have not been communicated by the bidder or its employees or agents to any person not an employee or agent of the bidder or its surety on any bond furnished with the bid or bids and will not be communicated to any such person prior to the official opening of the bid or bids;

That the bidder is legally entitled to enter into the contracts with the Campbell County Fiscal Court and is not in violation of any prohibited conflict of interest, including those prohibited by the provisions of KRS 164.390, 16.092, 61,096 and 42.990; and

(Applicable to corporations only) That as a foreign corporation we are registered with the Secretary of State, Commonwealth of Kentucky, and authorized to do business in the State ______or, That as a domestic corporation we are in good standing with the Secretary of State, Commonwealth of Kentucky ______. (Check the statement applicable.

That I have fully informed myself regarding the accuracy of the statements made in this affidavit.

NOTICE

Any agreement of collusion among bidders or prospective bidders which restrains, tend to restrain, or is reasonably calculated to restrain completion by agreement to bid at a fixed price, or to refrain from bidding or otherwise, is prohibited. The provision of KRS 355.080 and 305.000 which permit the regulation of resale price by contract do not apply to sales to the State, no sales to Local Governments.

Any person who violates any provisions of Kentucky Revised Statue 42.076 shall be guilty of a felony and shall be punished by a fine not less than five thousand dollars nor more than ten thousand dollars, or be imprisoned not less than one year no more than five years, or both such fine and imprisonment. Any firm,

Corporation or association which violates any of the provision of KRS 42.076 shall, upon conviction, be fined not less than ten thousand dollars no more than twenty thousand dollars.

In submitting this bid on the Bid Price Sheet, it is expressly agreed that upon proper acceptance by the Campbell County Fiscal Court of any or all items bid, a contract shall hereby be created with respect to the items accepted.

Signed by:	Date
Firm/Company	
Address	
Phone	

VIII. Required Affidavit for Bidders, Offerors, and Contractors Claiming Resident Bidder Status

For Bids and Contracts in General:

The bidder or offeror hereby swears and affirms under penalty of perjury that, in accordance with KRS 45A.494(2), the entity bidding is an individual, partnership, association, corporation, or other business entity that, on the date the contract is first advertised or announced as available for bidding:

- 1. Is authorized to transact business in the Commonwealth;
- 2. Has for one year prior to and through the date of advertisement
 - a. Filed Kentucky corporate income taxes;
 - b. Made payments to the Kentucky unemployment insurance fund established in KRS 341.49; and
 - c. Maintained a Kentucky workers' compensation policy in effect.


The BIDDING AGENCY (Campbell County Fiscal Court) reserves the right to request documentation supporting a bidder's claim of resident bidder statue. Failure to provide such documentation upon request shall result in disqualification of the bidder or contract termination.


Signature	_	Printed Nam	e	
Title	_	Date		
Company Name:				
Address:				
Subscribed and sworn to before me by:_	Affiant		Title	
	Amant		nue	
of (Company Name)	this	day of		, 20
Notary Public		/ My commiss		

IX.

References/List of Relevant Work1. Attach additional sheets if necessary

Project:	
Client:	
Contact Name:	
Phone Number:	
Email:	
Description of Work Performed:	
Project:	
Client:	
Contact Name:	
Phone Number:	
Email:	
Description of Work Performed:	
Project:	
Client:	
Contact Name:	
Phone Number:	
Email:	
Description of Work Performed:	

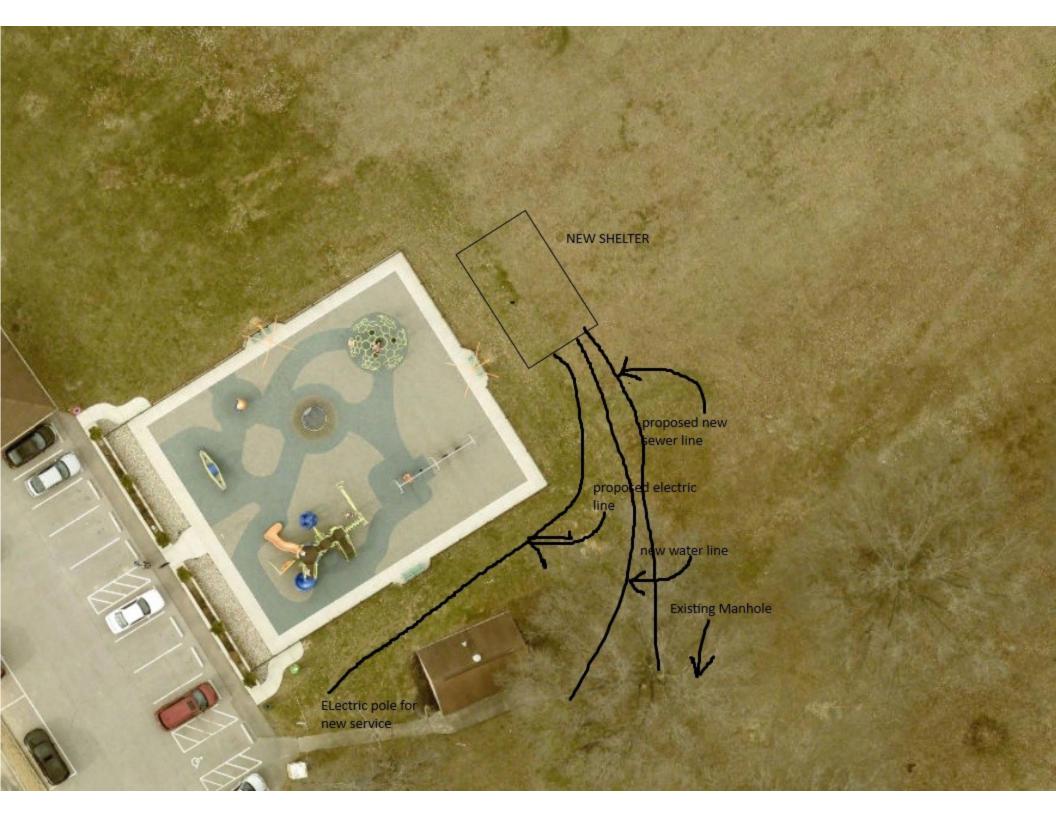

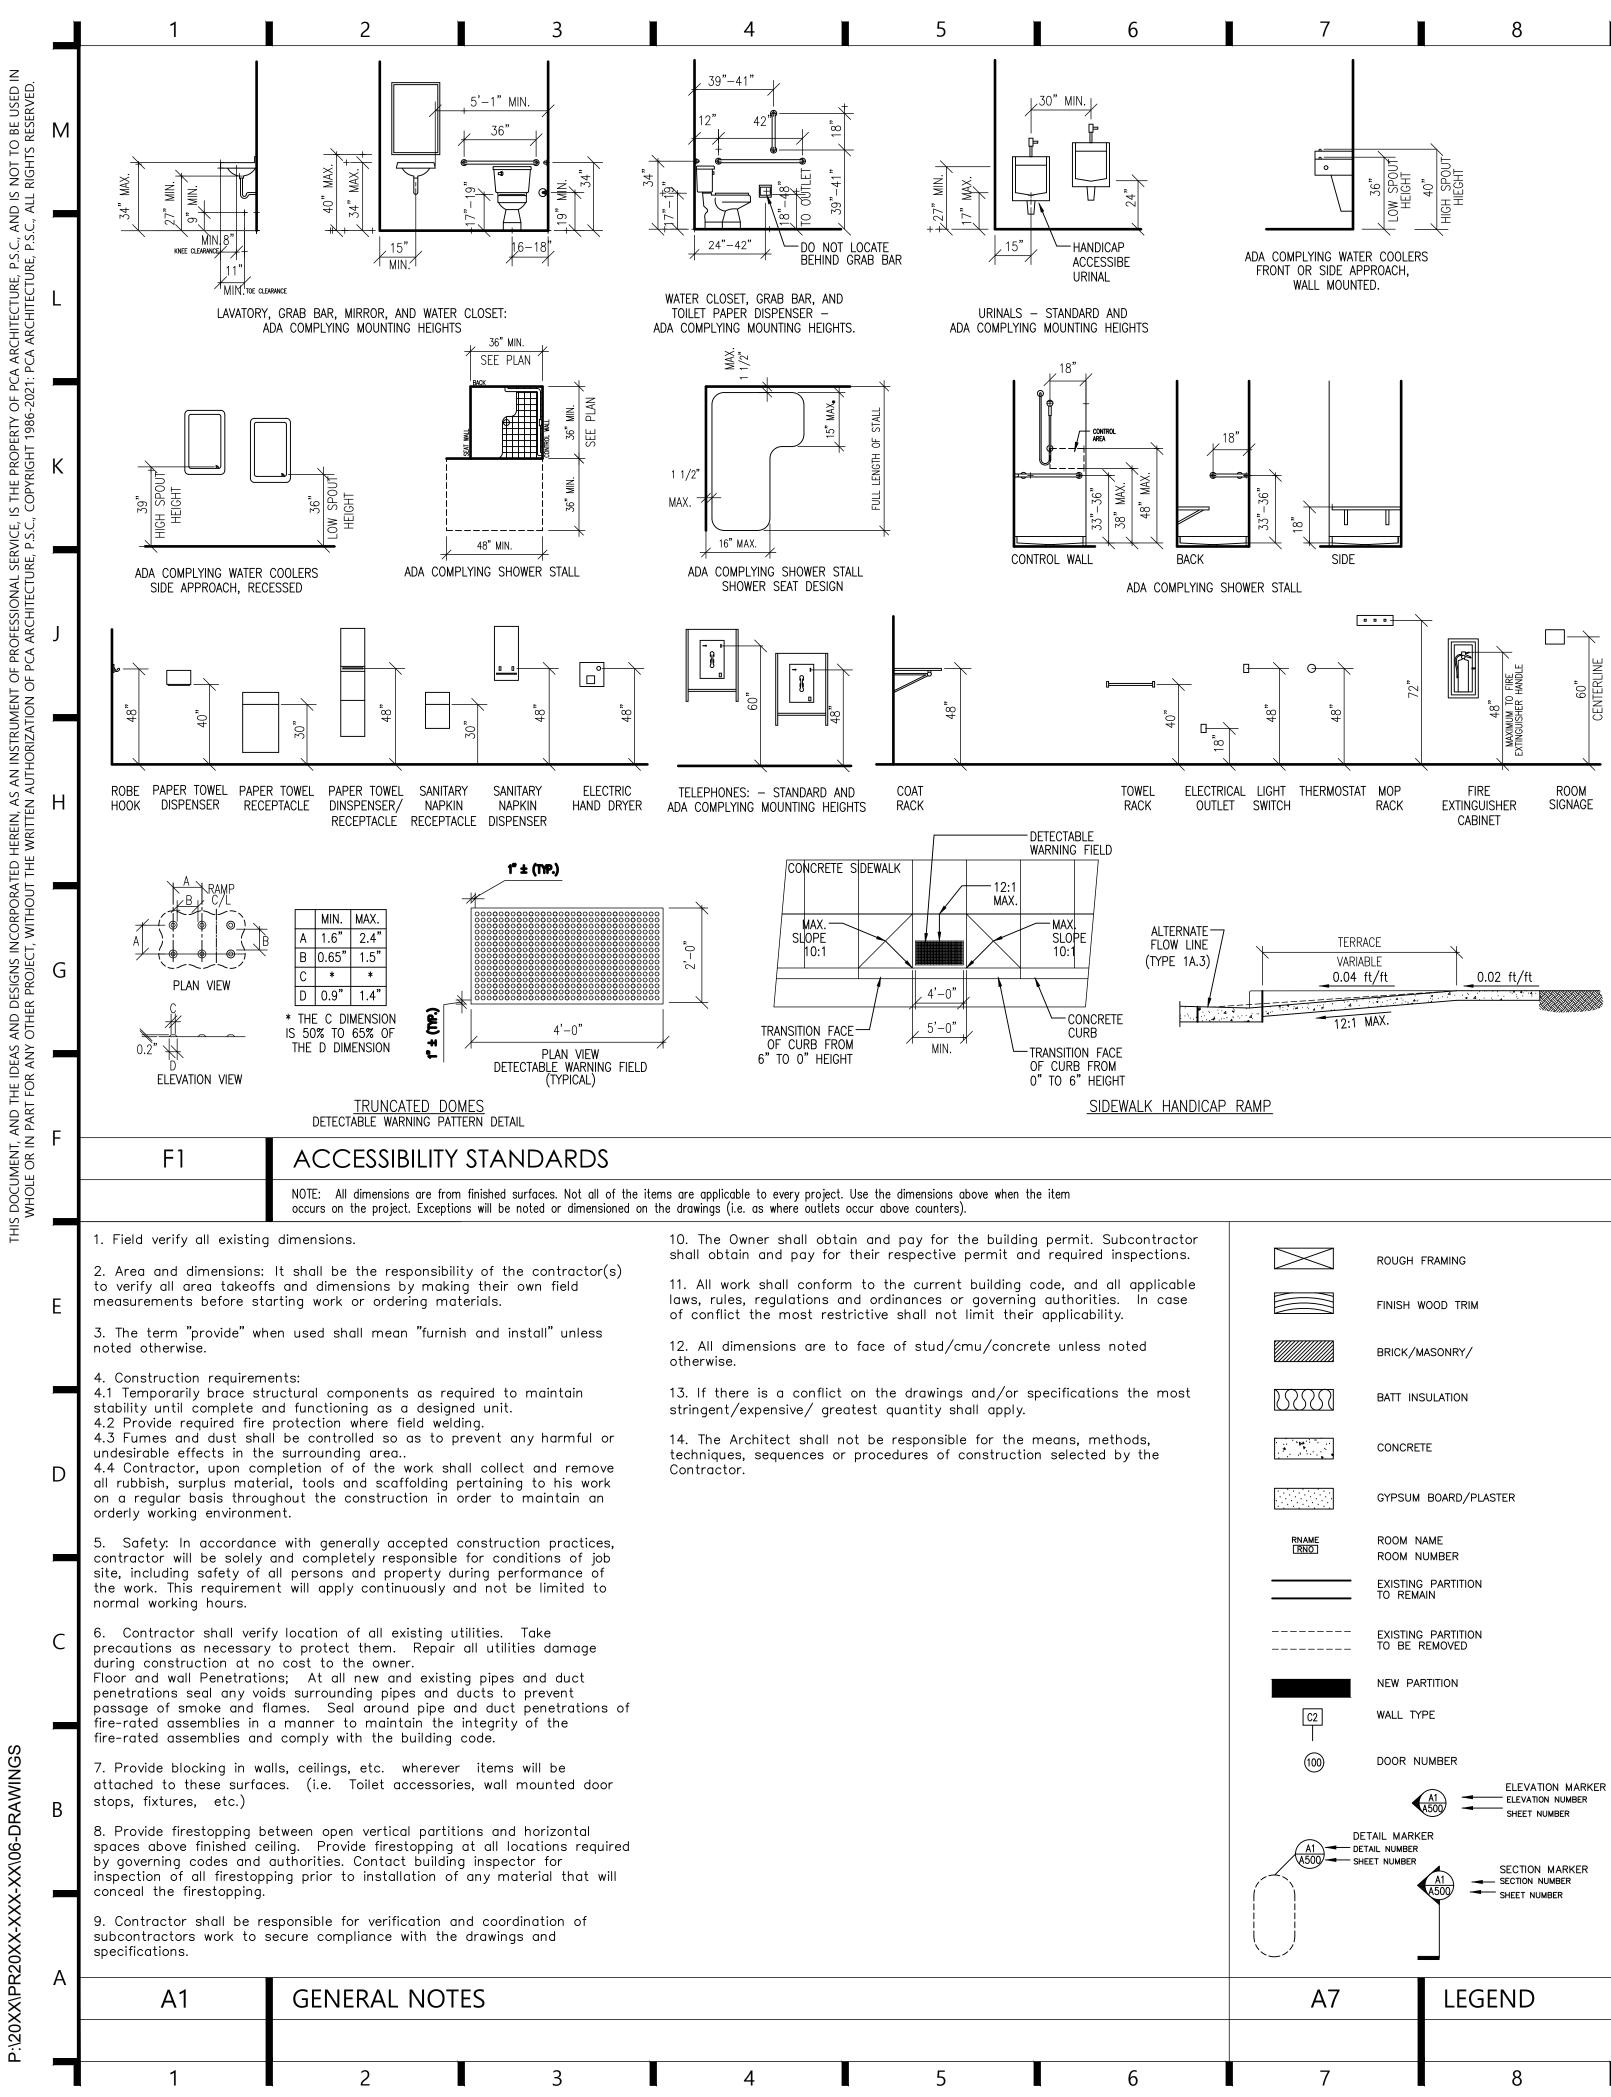

10 11 9

NEW SHELTER BUILDING A.J. JOLLY PARK 1505 RACE TRACK RD

DRAWING LIST

ARCHITECTURAL G100 COVER SHEET, CODE NOTES, GENERAL NOTES G101 GENERAL STRUCTURAL NOTES G102 GENERAL STRUCTURAL NOTES A100 FOUNDATION PLAN AND FLOOR PLAN A101 ROOF FRAMING PLAN AND REFLECTED CEILING PLAN A200 EXTERIOR ELEVATIONS A201 BUILDING SECTIONS AND DETAILS

HVAC, ELECTRIC, PLUMBING HVAC, ELECTRIC, AND PLUMBING DRAWINGS ARE TO BE SUBMITTED UNDER SEPARATE PERMIT BY THE RESPECTIVE DESIGN-BUILD CONTRACTORS.

CODE NOTES BUILDING CODE 2018 KBC


HEIGHT/AREA (1) story NEW BUILDING = 1078 SF

Ο


None

USE GROUP CLASSIFICATION U – Utility CONSTRUCTION TYPE VB Unprotected FIRE SUPPRESSION/FIRE ALARM

ALEXANDRIA, KY 41001

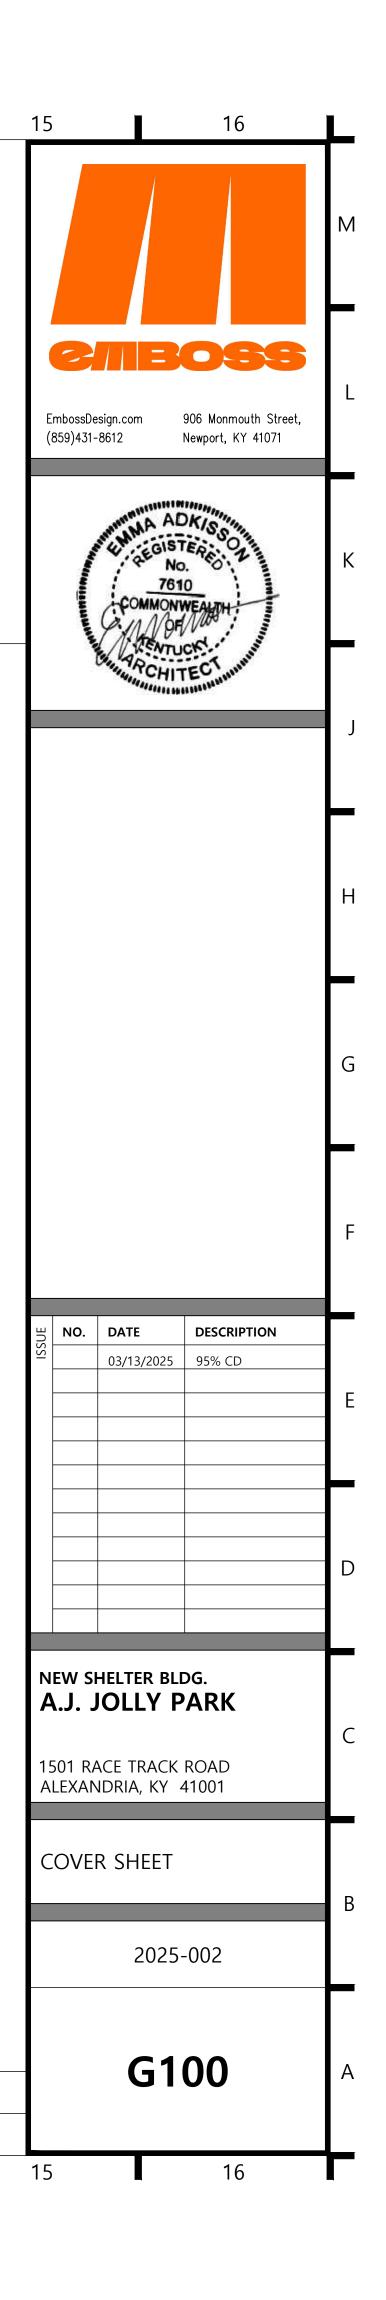

13

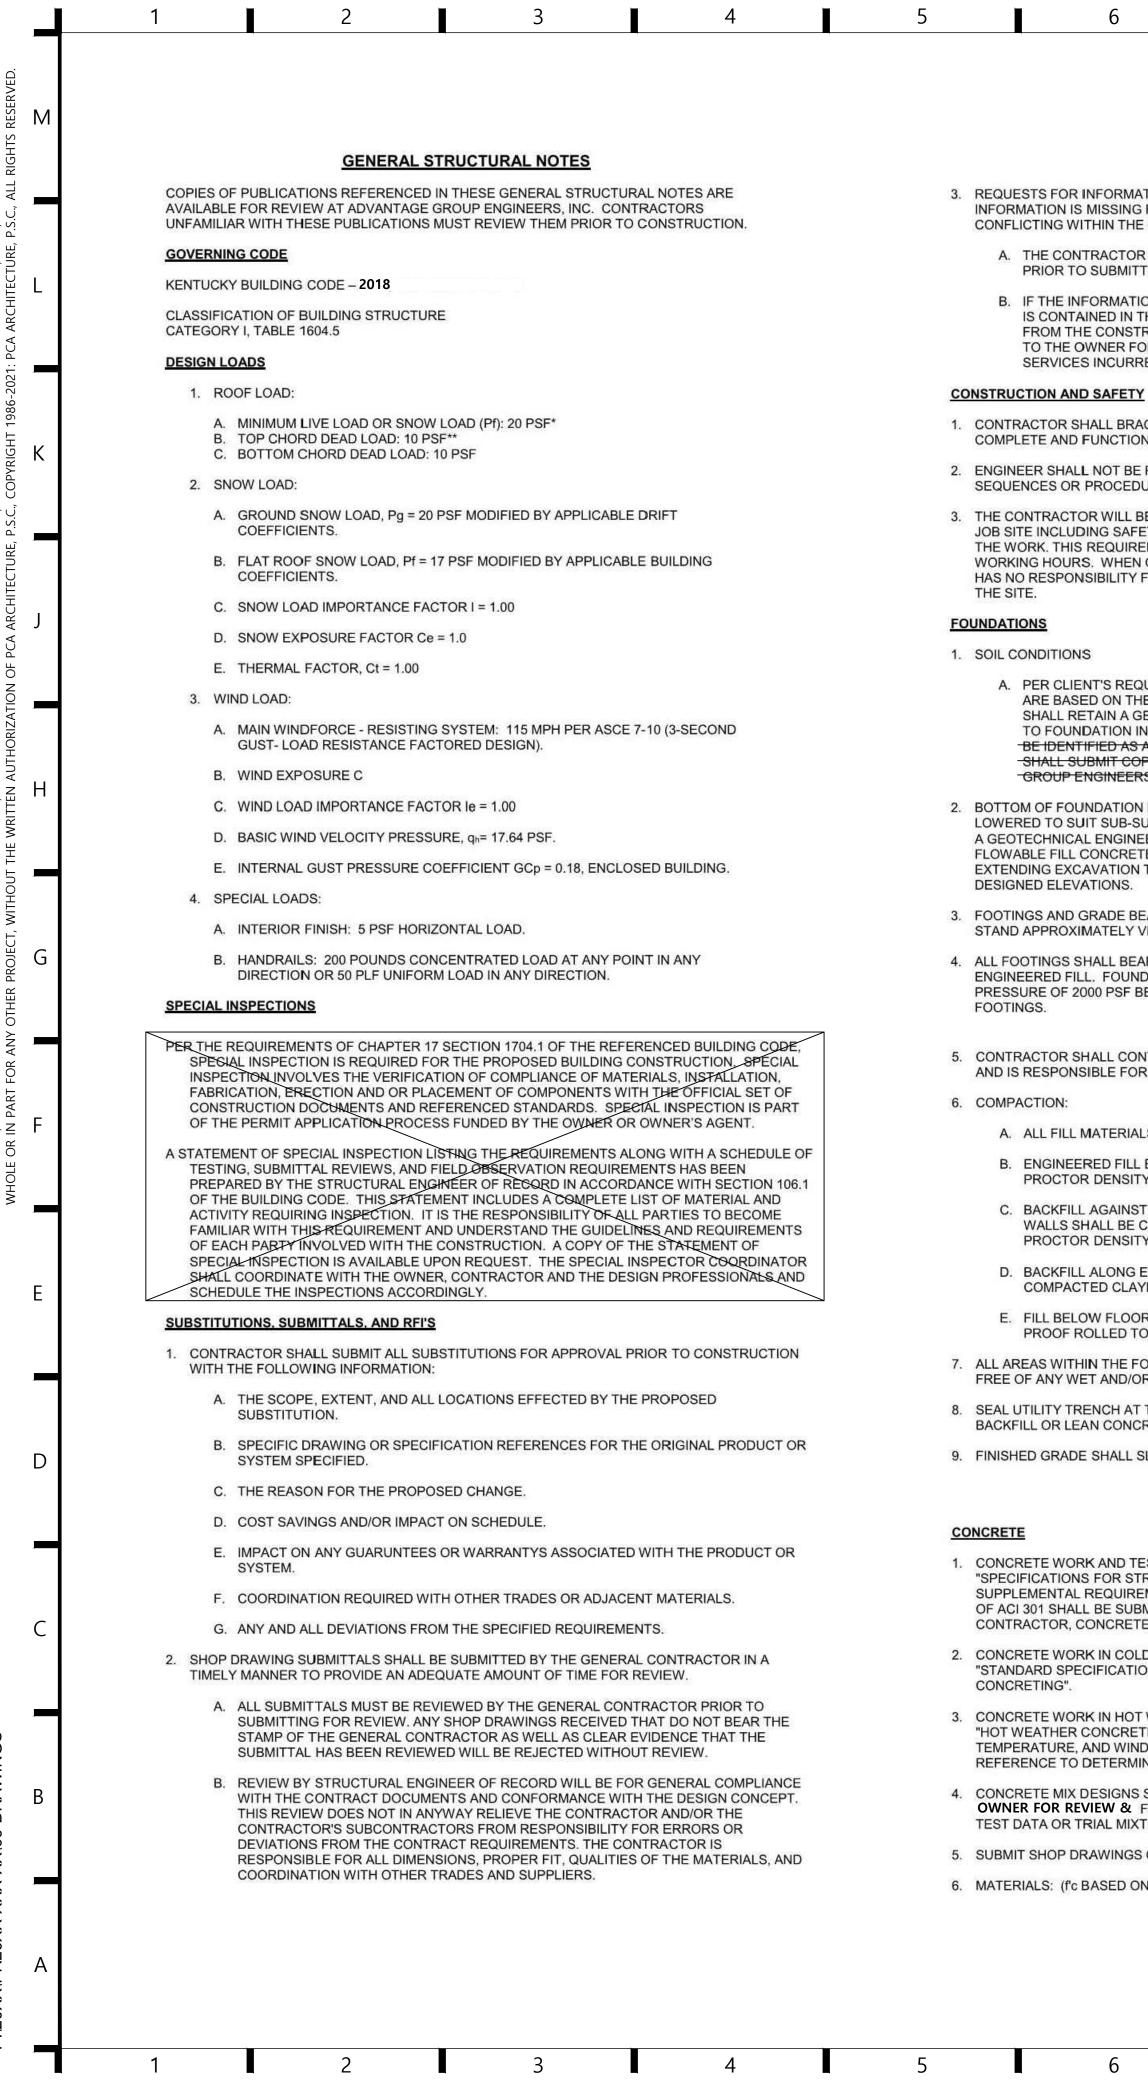

6	7	8	9	10	11
			t.		

3. REQUESTS FOR INFORMATION (RFI'S) SHALL BE SUBMITTED IN A TIMELY MANNER WHEN INFORMATION IS MISSING FROM THE CONSTRUCTION DOCUMENTS, INFORMATION IS CONFLICTING WITHIN THE CONSTRUCTION DOCUMENTS, OR IS AMBIGUOUS.

A. THE CONTRACTOR MUST USE DUE DILIGENCE IN ATTEMPING TO FIND ANY ANSWER PRIOR TO SUBMITTING AN RFI.

B. IF THE INFORMATION REQUESTED IN AN RFI IS APPARENT FROM FIELD OBSERVATION, IS CONTAINED IN THE CONSTRUCTION DOCUMENTS, OR IS REASONABLY INFERABLE FROM THE CONSTRUCTION DOCUMENTS, THE CONTRACTOR SHALL BE RESPONSIBLE TO THE OWNER FOR ALL REASONABLE COSTS CHARGED RELATED TO ADDITIONAL SERVICES INCURRED DUE TO ANSWERING THE RFI.

1. CONTRACTOR SHALL BRACE ENTIRE STRUCTURE AS REQUIRED TO MAINTAIN STABILITY UNTIL COMPLETE AND FUNCTIONING AS THE DESIGNED UNIT.

2. ENGINEER SHALL NOT BE RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES OF CONSTRUCTION SELECTED BY CONTRACTOR.

3. THE CONTRACTOR WILL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE INCLUDING SAFETY OF ALL PERSONS AND PROPERTY DURING PERFORMANCE OF THE WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS. WHEN ON SITE, THE ENGINEER IS RESPONSIBLE FOR HIS OWN SAFETY BUT HAS NO RESPONSIBILITY FOR THE SAFETY OF OTHER PERSONNEL OR SAFETY CONDITIONS AT

A. PER CLIENT'S REQUEST, THE FOUNDATION DESIGN AND GENERAL FOUNDATION NOTES ARE BASED ON THE ASSUMPTION OF FAVORABLE SOIL CONDITIONS. THE OWNER SHALL RETAIN A GEOTECHNICAL ENGINEER TO VERIFY DESIGN ASSUMPTIONS PRIOR TO FOUNDATION INSTALLATION. THE COST FOR THE GEOTECHNICAL ENGINEER SHALL BE IDENTIFIED AS A SEPARATE ITEM ON THE CONTRACTOR'S BID. THE CONTRACTOR SHALL SUBMIT COPIES OF THE GEOTECHNICAL ENGINEER'S REPORT TO ADVANTAGE GROUP ENGINEERS.

2. BOTTOM OF FOUNDATION ELEVATION INDICATED ARE FOR BIDDING PURPOSES AND MAY BE LOWERED TO SUIT SUB-SURFACE SOIL CONDITION. BEARING STRATA SHALL BE APPROVED BY A GEOTECHNICAL ENGINEER PRIOR TO PLACING CONCRETE. PROVIDE ENGINEERED FILL OR FLOWABLE FILL CONCRETE (500 PSI) UNDER FOUNDATIONS AT SOFT SPOTS AND FOR EXTENDING EXCAVATION TO ADEQUATE BEARING MATERIAL. INSTALL FOUNDATIONS AT DESIGNED ELEVATIONS.

3. FOOTINGS AND GRADE BEAMS MAY BE PLACED WITHOUT SIDE FORMS IF EXCAVATED WALLS STAND APPROXIMATELY VERTICAL.

4. ALL FOOTINGS SHALL BEAR ON LEVEL (WITHIN 1 IN 12) UNDISTURBED SOIL OR APPROVED ENGINEERED FILL. FOUNDATIONS HAVE BEEN DESIGNED FOR A MAXIMUM SOIL BEARING PRESSURE OF 2000 PSF BELOW STRIP FOOTINGS AND 2500 PSF BELOW ISOLATED COLUMN

CONTRACTOR SHALL CONTACT UTILITY COMPANIES FOR LOCATING UNDERGROUND SERVICES AND IS RESPONSIBLE FOR THEIR PROTECTION AND SUPPORT.

A. ALL FILL MATERIALS SHALL BE APPROVED BY A GEOTECHNICAL CONSULTANT. B. ENGINEERED FILL BENEATH FOOTINGS: MINIMUM COMPACTION 98% STANDARD

PROCTOR DENSITY AT THE OPTIMUM MOISTURE CONTENT. C. BACKFILL AGAINST FOUNDATION WALLS ALONG INTERIOR FACE OF FOUNDATION

WALLS SHALL BE CLAYEY MATERIAL COMPACTED IN 6" LIFTS TO 95% STANDARD PROCTOR DENSITY OR CONCRETE WITH A COMPRESSIVE STRENGTH OF fc = 500 PSI.

D. BACKFILL ALONG EXTERIOR FACE OF SHALLOW WALL FOUNDATIONS TO BE COMPACTED CLAYEY MATERIAL; COMPACT TO 95% STANDARD PROCTOR.

E. FILL BELOW FLOOR SLABS TOP 12" OF SUBBASE BELOW INTERIOR FLOOR SLAB TO BE PROOF ROLLED TO 98% STANDARD PROCTOR DENSITY PRIOR TO PLACEMENT OF SLAB.

7. ALL AREAS WITHIN THE FOOTPRINT OF THE BUILDING, INCLUDING UTILITY TRENCHES, MUST BE FREE OF ANY WET AND/OR SOFT AREAS PRIOR TO PLACEMENT OF FILL MATERIAL OR SLAB.

8. SEAL UTILITY TRENCH AT THE EXTERIOR FOUNDATION WALL BY USING A COMPACTED CLAYEY BACKFILL OR LEAN CONCRETE TO CREATE A DAM TO PREVENT ENTRY OF WATER.

9. FINISHED GRADE SHALL SLOPE AWAY FROM THE PERIMETER FOUNDATION.

1. CONCRETE WORK AND TESTING SHALL CONFORM TO ALL REQUIREMENTS OF ACI 301, "SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS", EXCEPT AS MODIFIED BY THE SUPPLEMENTAL REQUIREMENTS BELOW. REPORTS FROM TESTS REQUIRED BY SECTION 1.6 OF ACI 301 SHALL BE SUBMITTED TO STRUCTURAL ENGINEER, ARCHITECT, OWNER, CONTRACTOR, CONCRETE SUPPLIER, AND BUILDING OFFICIAL.

2. CONCRETE WORK IN COLD WEATHER SHALL CONFORM TO ALL REQUIREMENTS OF ACI 306.1 "STANDARD SPECIFICATION FOR COLD WEATHER CONCRETING"AND ACI 306R "COLD WEATHER

3. CONCRETE WORK IN HOT WEATHER SHALL CONFORM TO ALL REQUIREMENTS OF ACI 305R "HOT WEATHER CONCRETING". THE AIR TEMPERATURE, RELATIVE HUMIDITY, CONCRETE TEMPERATURE, AND WIND VELOCITY SHALL BE ENTERED INTO THE NOMOGRAPH OF THIS REFERENCE TO DETERMINE IF PRECAUTIONS AGAINST PLASTIC SHRINKAGE ARE REQUIRED.

4. CONCRETE MIX DESIGNS SHALL BE SUBMITTED FOR EACH TYPE OF CONCRETE TO THE OWNER FOR REVIEW & FOR APPROVAL IN ACCORDANCE WITH ACI 301 SECTION 4.2.3.4 FIELD TEST DATA OR TRIAL MIXTURES.

5. SUBMIT SHOP DRAWINGS OF REINFORCING STEEL.

6. MATERIALS: (fc BASED ON 28 DAY UNLESS NOTED)

A. CONCRETE UNLESS NOTED: fc = 4000 PSI., NORMAL AGGREGATE.

- B. CONCRETE FOR INTERIOR FLOOR SLABS: fc = 4000 PSI AT 28 DAYS NORMAL WEIGHT AGGREGATE, MINIMUM PORTLAND CEMENT CONT TABLE 4.2.2.1, WATER NOT PERMITTED TO BE ADDED AT THE SITE, REQUIRED, MAXIMUM WATER/CEMENTITIOUS RATIO = 0.50.
- C. CONCRETE FOR EXTERIOR FLAT WORK, WALKS, ETC .: fc = 4500 PSI ENTRAINED AIR), MINIMUM PORTLAND CEMENT CONTENT = 520 #/CY WATER/CEMENTITIOUS RATIO = 0.45.
- D. CONCRETE FOR FOUNDATION WALLS AND RETAINING WALLS WITH EXPOSURE: fc = 4000 PSI, (4.5% TO 7.5% ENTRAINED AIR), MAXIMUM WATER/CEMENTITIOUS RATIO = 0.50.
- E. CONCRETE FOR FOOTINGS: fc = 3000 PSI.
- F. CONCRETE FOR DRILLED PIERS: fc = 3000 PSI.
- G. REINFORCING STEEL: ASTM A615 OR ASTM 996 (AXLE ONLY) 60 KSI BARS AND ASTM A185 MESH, FLAT SHEETS ONLY.
- H. FLY ASH: ASTM C618, TYPE F OR C. FLY ASH-TO- TOTAL CEMENTITI NOT EXCEED 25% MAXIMUM.
- I. GROUND GRANULATED BLAST FURNACE SLAG: ASTM C989. TOTAL GRANULATED BLAST FURNACE SLAG -TO- TOTAL CEMENTITIOUS RA EXCEED 50% MAXIMUM.
- J. HIGH RANGE WATER REDUCER (HRWR) ADMIXTURE: ASTM C494.
- K. CHLORIDE CONTENT OF CONCRETE: LIMIT TOTAL CHLORIDE ION C INDICATED IN TABLE 4.2.2.6 OF ACI 318. ADMIXTURES CONTAINING PERMITTED IN REINFORCED CONCRETE OR CONCRETE CONTAINING

7. SLUMP SHALL BE MEASURED PRIOR TO THE ADDITION OF HRWR.

- LAP SPLICE REINFORCING BARS 48 BAR DIAMETERS UNLESS NOTED OTHE
- 9. BAR CLEARANCES BETWEEN ADJACENT BARS AND FORMWORK SHALL BE DRAWINGS OR A MINIMUM AS PER ACI REQUIREMENTS.
- 10. AT CORNERS AND INTERSECTIONS OF FOOTINGS, WALLS AND GRADE BEA BARS OF EQUAL SIZE AND AT SAME SPACING AS TYPICAL REINFORCING AI AND/OR INTO ABUTTING WALL OR GRADE BEAM. BARS SHALL HAVE EMBED DIAMETERS (18" MIN.).
- 11. SEE ARCHITECTURE PLAN FOR SLAB FINISH.CURE USING A METHOD RECO 302.1R (GUIDE FOR CONCRETE FLOOR AND SLAB CONSTRUCTION) INCLUD WET COVERING, APPLICATION OF IMPERVIOUS SHEETING OR APPLICATION SEAL" TYPE CURING COMPOUND MEETING ASTM C-1315. FOR APPLICATIO SUNLIGHT USE CLASS A (NON-YELLOWING) CURING COMPOUND. COORDII METHOD WITH ARCHITECTURAL FLOOR FINISHES THAT REQUIRE ADHESIO (SUCH AS TILE) TO INSURE PROPER BOND.
- 12. FLOOR SLAB-ON-GRADE SHALL CONFORM TO THE FOLLOWING SURFACE F TOLERANCES PER ASTM E-1155 AND ACI 117: Ff(FLATNESS) FI(LEVELNESS)
 - A. SPECIFIED OVERALL VALUE: 25 / 20
 - B. MINIMUM LOCAL VALUE: 18 / 13
 - C. MAXIMUM GAP UNDER 10 FT. UNLEVELED STRAIGHTEDGE = 1/4".
- 13. SEE ARCHITECTURAL DRAWINGS AND SPECIFICATIONS FOR VAPOR BARRI VAPOR BARRIER, WHERE REQUIRED, SHALL BE PLACED OVER COMPACTED SUBBASE.
- 14. AT SLAB AND WALL OPENING CORNERS AND REENTRANT CORNERS, PROV EACH FACE PARALLEL TO EACH EDGE EXTENDING A MINIMUM OF 2'-0" PAS THIS STEEL MAY BE OMITTED IF TYPICAL REINFORCING STEEL EXCEEDS TH REQUIREMENT.
- 15. REINFORCE ALL INTERIOR SLABS ON GROUND WITH 6 X 6 W2.9 X W2.9 (42) MESH 2" CLEAR BELOW TOP OF SLAB.
- 16. LAP WELDED WIRE FABRIC MINIMUM 1 FULL SPACE PLUS 2".
- 17. FINISH OF CONCRETE HANDICAP RAMPS TO CONFORM TO THE REQUIREM AMERICANS WITH DISABILITIES ACT (ADA). COORDINATE LOCATION AND PA ARCHITECTURAL DRAWINGS.
- 18. CONTROL JOINTS IN SLABS ON GROUND SHALL BE LOCATED AT 15'-0" MAXI SHALL CREATE SECTIONS OF SLAB WITH A MAXIMUM ASPECT RATIO OF 11 JOINTS SHALL BE SAWN AND SHALL BE A MINIMUM OF 1/4 OF THE SLAB THIC CONTROL JOINT SHALL BE SAWN AS SOON AS THE SAW BLADE CAN CUT TH WITHOUT DISPLACING THE AGGREGATE. CUT EVERY OTHER MESH WIRE / JOINT LOCATION PRIOR TO PLACING CONCRETE. IF AN EARLY-CUTTING SA SHALLOWER DEPTH OF THE CUT IS DESIRED, CONTACT THE ENGINEER IN / APPROVAL.
- 19. CONSTRUCTION JOINTS IN SLABS ON GROUND MAY BE LOCATED AT ANY C LOCATION. CONSTRUCTION JOINTS SHALL HAVE A KEY FORMED AT MID-DI CAST SECTION. THE KEY SHALL BE 11/2 " DEEP AND SHALL BE 1/3 OF THE SI HIGH. THE TOP AND BOTTOM OF THE KEY SHALL HAVE 1 VERTICAL TO 3 HO
- 20. PROVIDE 3/4" CHAMFER AT CORNERS OF EXPOSED CONCRETE.
- 21. WHERE BRITTLE FLOOR FINISHES ARE TO BE APPLIED TO FLOOR SLABS. C CONTROL JOINT LOCATIONS WITH FLOOR FINISH JOINT LOCATIONS AND AF

EXPANSION AND EPOXY ADHESIVE ANCHORS


EXPANSION ANCHORS:

 EXPANSION ANCHORS SHALL BE MANUFACTURED BY SIMPSON S-T/HILTI TYPE, SIZE, AND EMBEDMENT INDICATED ON DRAWINGS. INSTALL PER MA RECOMMENDATIONS. SUBSTITUTES MAY BE CONSIDERED; SUBMIT MANUF PRIOR TO INSTALLATION.

EPOXY ADHESIVE ANCHORS:

12	13	14	15		16	
'S, 1800 PSI AT 3 DAYS, NTENT PER ACI 301 , HRWR ADMIXTURE			2	MB	059	5
SI, (4.5% TO 7.5% CY, MAXIMUM			EmbossD (859)431		906 Monmouth Stree Newport, KY 41071	×t,
'H EXTERIOR IM				REGIST	KISSON	
SI YIELD DEFORMED			¹ 4412เมเนเน ^{เนพ}	COMMON	NEALDH	
AL GROUND RATIO SHALL NOT				ARCHIT	CKT.	
CONTENT TO AMOUNT G CHLORIDE ARE NOT ING METALS.						
ERWISE:						
E AS NOTED ON THE						
AMS, PROVIDE BENT AROUND CORNER EDMENT OF 30						
COMMENDED BY ACI IDING WATER CURING, ON OF "CURE AND ONS EXPOSED TO DINATE CURING ION TO THE SLAB						
PROFILE						
RIER REQUIREMENTS. ED GRANULAR			ISSUE	DATE	DESCRIPTION	
OVIDE (1) #5 BAR IN AST EDGE OF OPENING. THIS MINIMUM			<u> </u>	03/13/2025	95% CD	
42#) MESH. LOCATE						
MENTS OF THE PATTERN WITH						
XIMUM SPACING AND 1½ TO 1. CONTROL						
IICKNESS DEEP. THE THE CONCRETE AT THE CONTROL						
SAW IS BE USED AND A N ADVANCE FOR						
CONTROL JOINT DEPTH OF THE FIRST SLAB THICKNESS HORIZONTAL SLOPE.				JOLLY P		
COORDINATE				NDRIA, KY		
ARCHITECT.			GENERAL STRUCTURAL NOTES			
AND SHALL BE THE IANUFACTURER'S UFACTURER'S DATA				2025	-002	
				G1	01	_
				U I	UI	_
12	13	14	15		16	-

 La serie constructions of the serie constructions of the series of the se	 Lange and a substrate of the substrate of th	A FRANK ADURANTE AUAUU RE OFT VD HIGH OTDENICTH RY CHIRCON STRANG TH	
 Marcia Control A Califord A Cal	 A. Matter 1. A BANKA STANDARD AND AND AND AND AND AND AND AND AND AN	PER MANUFACTURER'S RECOMMENDATIONS. SUBSTITUTES MAY BE CONSIDERED; SUBMIT	#4 BAR – 24" MINIMUM LAP
 Instruction of the second secon	 NUMBER NUMBER		
<text></text>	<text></text>	3. FOR SAFE AND PROPER INSTALLATION, HANDLING, AND STORAGE OF THE EPOXY SYSTEM.	
Numera Notes Numera Numera A Contract Manufactor That Have and Books for A - In Works ANY of The Link ANY of A - In Works ANY of The Link ANY of A - In Works ANY O	 Mutany and any and any any any any any any any any any any	MASONRY	13. GROUT ALL CELLS BELOW GRADE SOLID.
 2 Control Control	 Province of the second s	"SPECIFICATION FOR MASONRY STRUCTURES (ACI 530.1/ASCE 6/TMS 602)" EXCEPT AS	
 JUNICH SIGNAL FORMER TORUMENT CONTINUES OF A DECISION OF A	 JANDALE SAME LEARNER CONTRACT LEARNER CONTRA		
 J. Barton Handbard Barton Handbar	 I. BARTONIC DEPENDENCIPAL DEPEN	A. CONCRETE MASONRY: fm = 1500 PSI AT 28 DAYS.	1. 2 x 8 AND LARGER: NO. 1 GRADE OR BETTER SOUTHERN PINE KILN DRIED.
 A. Source Construction Honoremut A. Source Construction Honoremut 	 A. Source is construction model with a set of the set	3. SUBMITTALS SHALL BE MADE FOR THE FOLLOWING:	
 In the Ansatz Control Contro	 In the Name of Control Contenter Control Control Control Control Control Control Control	A. COLD WEATHER CONSTRUCTION PROCEDURE.	
 Bits Portunes where the control best where the control	 Buscher Vertregen vertr	B. HOT WEATHER CONSTRUCTION PROCEDURE.	 ACQ-C (ALT CA-B OR SBX-DOT) PRESSURE TREAT PIECES IN CONTACT WITH FOUNDATION OR EXPOSED TO WEATHER.
 Provide Transmission Structure Provide Pr	 A UNAPPENDENCE OF ADVANCE FOR APPENDENCE UNAPPENDENCE FOR APPENDENCE UNAPPENDENCE OF ADVANCE APPENDENCE OF ADVANCE APPE	STEEL POSITIONERS, MOVEMENT JOINT MATERIALS, TIES & ANCHORS.	32/16 APA RATED ROOF SHEATHING EXPOSURE 1. 24/16 APA RATED STRUCTURAL WALL SHEATHING EXPOSURE 1. ALL SHEATHING TO BE NAILED WITH 8d NAILS AT 6" ON CENTER AT
 I. NUMBER OF INTERS OF INTERS IN A REQUESTION OF THE INFORMATION OF A REPORT OF	 I. NUCCESSION CONTRACT ALLER AND ADDRESSION CONTRACT ADDRESS ADDRESSION CONTRACT ADDRESS ADDR	E. MANUFACTURER'S CERTIFICATE OF COMPLIANCE FOR SPECIFIED MASONRY UNIT, AND	ROOF AND WALL SHEATHING SHALL BE SPACED A MINIMUM 1/8" AT PANEL EDGES AND ENDS OF SHEETS. USE APPROPRIATE PLYWOOD CLIPS AS RECOMMENDED BY THE APA. ALL PLYWOOD
 Matternal Matternal	 Martine I Martine I	F. PROPORTIONS OF MATERIAL IN ACCORDANCE WITH REFERENCED SPECIFICATIONS OF	3. UNLESS NOTED OTHERWISE, CONNECTORS SHALL BE MADE PER TABLE 2304.9.1, "RECOMMENDED FASTENING SCHEDULE", IN REFERENCED BUILDING CODE. STAPLES NOT
 A. CODENE LARGENCY LINE ASTRUCE THE LARGENCY HALL AND READE AND READE AND READE AND READE AND READER AND REA	 A. CODER LE ARCHIVE UNE ASTRUCT TRE LANDOR UNE LA NOTALE INSTALLE VIELE CONFECTION UNIT ALL ENVIRONMENT LE ANDRE CONFECTION UNIT ALL ENVIRONMENT LE		PERMITTED FOR FASTENING APA RATED SHEATHING AND SUBFLOORING.
 Addecant PERAPTICAL FOR ARM COST IN PERAPTICAL AND CONSIGNATION OF CLARMER ARM COST IN PERAPTICAL AND PERAPTICAL AND PERAPTICAL AND COST IN PERAPTICAL AND COST IN PERAPTICAL AND COST IN PERAPTICAL AND PERAPTICAL AND	 Modelaufi PER ANT LOSI CHINORMAL PERAT. Modelaufi PER ANT COST NET WARK PORTUPO CENERT. LAS MAY COST NET WARK PORTUPO CENERT. MAY COST NET WARK PORTUPO CENERT. MAY COST NET WARK PORTUPO CENERT. MAY MAY MAY MAY MAY MAY MAY MAY MAY MAY		MANUFACTURED BY THE SIMPSON STRONG-TIE COMPANY AND SHALL BE FASTENED AS
 POTULING CALEFULATION OF ALL PROTECTION OF ALL PROTEC	 PORTLAND CENENTLANE NORTHAR ART CONTINUED CENENT THE LANDRAFED LIKE THE SECOND SECOND CENENT AND THE NOTICE AND ART ART ART CONTINUED SECOND SE	AGGREGATE PER ASTM C331 OR NORMAL WEIGHT.	MEMBER AT EACH BEARING LOCATION IN ADDITION TO THE TYPICAL NAILING REQUIREMENT IN
 Modeline Clearent Modelines, Justice Porton. A. Gouris Constraints (E. M. 1998). Subject Porton. Modeline Clearent Modelines, Subject Porton. Modelines, State Porton.<td> Modeline Cleaner Modeline Subject Actional Subject For Disk Modeline Cleaner Modeline Subject For Disk Modeline Subject For Disk Modeline Cleaner Modeline Subject For Disk Modeline Subject For Disk Modelin</td><td></td><td></td>	 Modeline Cleaner Modeline Subject Actional Subject For Disk Modeline Cleaner Modeline Subject For Disk Modeline Subject For Disk Modeline Cleaner Modeline Subject For Disk Modeline Subject For Disk Modelin		
 F. BOUT. ASTH ORD. 7: 4 200 W, SLUMP 57 1017. F. REDORGOM STELL: STAN AND K. OK SYNLLD. F. REDORGOM STELL: STAN AND K. OK SYNLLD. F. HORDONTAL, DOIT RENORCOM FOR STRUKLE WYTH COUNTERS WRITCH AND AND STARS 9. ACC MICROST 9. SALVES 57 1001 PH TRUSS 51 WLL DE EXSENSE DUI DE EXSENSE DUI DE SUBJECTION ON MUTAL AND AND STARS 9. ACC MICROST 9. SALVES 57 1001 PH TRUSS 51 WLL DE EXSENSE DUI DE EXSENSE DUI DE SUBJECTION ON MUTAL AND AND STARS 9. ACC MICROST 9. SALVES 57 1001 PH TRUSS 51 WLL DE EXSENSE DUI DE EXSENSE DUI DE SUBJECTION ON MUTAL AND AND STARS 9. ACC MICROST 9. SALVES 57 1001 PH TRUSS 51 WLL DE EXSENSE DUI DE SUBJECTION ON MUTAL AND AND STARS 9. ACC MICROST 9. SALVES 57 1001 PH TRUSS 51 WLL DE EXSENSE DUI DE SUBJECTION ON MUTAL AND AND STARS 9. ACC MICROST 9. SALVES 57 1001 PH TRUSS 51 WLL DE EXSENSE DUI DE SUBJECTION ON MUTAL AND AND AND SALVES 57 1001 PH TRUSS 51 WLL DE EXSENSE 1001 PH TRUSS 51 WLL DE EXSENSE 1001 PH TRUSS 51 WLL DE SUBJECTION ON MUTAL AND AND TRUSS 51 WLL DE EXSENSE 1001 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION PH TRUSS 51 WLL DE SUBJECTION PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION PH TRUSS 51 WLL DE SUBJECTION ON WITCH 1000 PH TRUSS 51 WLL DE SUBJECTION	 F. BOUT. ASTH ORD. 7: - 200 (u). SUMP 57 1017. F. REDFORDED STELL: STAM AND (S K) STALLD. F. REDFORDED STELL: STAM AND (S K) STALLD. F. REDFORDED STELL: STAM AND (S K) STALLD. F. REDFORDED STALL: STAM AND (S K) STALLD. F. REDFORDED STALL: STAM AND (S K) STALLD. F. REDFORDED STALL: STAM AND (S K) STALLD. F. REDFORDED STAM AND STAM AND STAM AND STAM AND (S K) STALLD. F. REDFORDED STAM AND STAM AND STAM AND STAM AND (S K) STALLD. F. REDFORDED STAM AND STAM AND STAM AND STAM AND AND (S K) STALL STAM AND (S K) STALLD. F. REDFORDED STAM AND STALLS STAM AND STALLS STAM AND STALLS STALLD. F. REDFORDED STALL STAM AND STALLS STAM AND STALLS STALLD. F. REDFORDED STALL STAM AND STALLS STAM AND STALLS STALLD. F. REDFORDED STALL STAM AND STALLS STAM AND STALLS STAM AND STALLS STALLD. F. REDFORDED STAM AND STALLS STAM AND STAM	E. MASONRY CEMENT MORTAR: AT CONTRACTOR'S OPTION.	
 B. BERGEROND STEEL, SATU ASTO, SP AST MELD. B. HORCOND STEEL, SATU ASTO, SP AST MELD. B. HORCOND STEEL, SATU ASTO, SP AST MAISS CASS. IF ACCE HORCOND. B. HORCONDOR ASTORES AND MANDED ASTORES IN A MARKED OF RESTINGTION ASTOLES AND MANDED ASTORES MANDED AST	 B. BERGERONS STELL ASTINATIS DR SINCE WITHEOUCHTE DASCHETE MASCINKT: 5 GAUGE LACCESTATE LONG STATE ASTINATIS DASS B. "A DE INCIDICATION CONTRACTION CONTR	F. GROUT: ASTM C476. f"c = 2000 psi, SLUMP 8" TO 10".	TRUSSES" (TPI) OR "DESIGN SPECIFICATION FOR METAL PLATE CONNECTED PARALLEL CHORD
 H HAZDYAL, JOHT REMOVEDING KY ENALGY, EVILLE CINCLE & MASARY, E AURAGE, MY LE CONCEPT & MASARY, MY LE MASARY, M	 H. HARDAYAL, JOHT BERNORCH ET KURLE, WYTE CONCETE IL MARKEY BLAURE DOT THE DESIGNATION SALL LESS TO CONSECT MARKEY BLAURE MARKEY AL, JOHT SENDOLING AT THE CONCENTS VERTICAL PROFECTION WALL SENDOLING AT THE CONCENTS VERTICAL PROFECTION CONSECT MARKEY MARKEY AL, JOHT SENDOLING AT MARKEY BLAURE PROFECTION ALL SENDOLING WALL SENDOLING AT THE ACCURATE VERTICAL PROFECTION ALL SENDOLING AND THE ACCURATE VERTICAL PROFECTION ALL SENDOLING ALL SENDOLING AND THE ACCURATE VERTICAL PROFECTION ALL SENDOLING ALL SENDOLING ALL PROFECTION ALL PROFECTION ALL SENDOLING ALL SENDOLING ALL PROFECTION ALL PROFECTION ALL PROFECTION ALL PROFECTION ALL PROFECTION ALL PROFECTION ALL PROFECTION ALL PROFECTION ALL PROFECTION ALL PROFECTION ALL PROFECTION ALL PROFECTION ALL PROFECTION ALL PROFECTION ALL PROFECTION	G. REINFORCING STEEL: ASTM A615, 60 KSI YIELD.	
Morrial reginant loss multiple accounting the accounting to Murkey, ado Balenting accounting to Murkey, ado Balenting accounting to Murkey, ado Balenting accounting accounter accounting accounting accounting accounting accounting accoun	Monital Product Nations and Account Number of Advances, and Caleford in Marking, and Caleford in Advances, and Calef	LADDER TYPE. HOT DIPPED GALVANIZED PER ASTM A153 CLASS B. PLACE HORIZONTAL JOINT REINFORCING AT 16" CENTERS VERTICALLY FOR CONCRETE MASONRY. LAP HORIZONTAL JOINT REINFORCING 6" MINIMUM. HORIZONTAL JOINT REINFORCING	THE DESIGN LOAD SECTION OF THESE NOTES. 3. SHOP DRAWINGS ARE REQUIRED AND SHALL BEAR THE DESIGNER'S ENGINEERING SEAL, SHOW ALL DESIGN AND FABRICATION DATA, TEMPORARY AND PERMANENT BRACING REQUIREMENTS, AND HANDLING AND ERECTION INSTRUCTIONS. SHOP DRAWINGS SHALL
 MINIMUM VERTICAL REINFORCEMENT REQUIREMENTS FOR ALL MASONRY WALLS. A. AS A MINIMUM, ALL MASONRY SHALL BE REINFORCED PER SECTION ACLSSO 11.12.22.1 B. AV RETICAL, RASS SHALL BE PLACED AT ALL CONKERS, WITHIN 16 IVIERS OF EACH MINIMUM VERTICAL, RASS SHALL BE PLACED AT ALL CONKERS, WITHIN 16 IVIERS OF EACH MINIMUM VERTICAL, RASS SHALL BE PLACED AT ALL CONKERS, WITHIN 16 IVIERS OF EACH MINIMUM VERTICAL, RASS SHALL BE SHACED AT ALL CONKERS, WITHIN 16 IVIERS OF EACH MINIMUM VERTICAL, RASS SHALL BE SHACED AT ALL CONKERS, WITHIN 16 IVIERS OF EACH MINIMUM VERTICAL, RASS SHALL BE SHACED AT ALL CONKERS, WITHIN 16 IVIERS OF EACH MINIMUM VERTICAL, RASS SHALL BE SHACED AT ALL CONKERS, WITHIN 16 IVIERS OF EACH MINIMUM VERTICAL, RASS SHALL BE SHACED AT ALL CONKERS, WITHIN 16 IVIERS OF EACH MINIMUM VERTICAL, RASS SHALL BE SHACED AT IVIER AT MERS MINIMUM VERTICAL, RASS SHALL BE SHACED AT IVIER THESE SHALED AT IVIER THESE SHALL BE SHACED AT IVIER THESE SHALL BE AND ECONFECTION WICH SHALL SHALL DOWT REINFORCEMENT SHALL BE SHACED AT IVIER THESE SHALL BE AND ECONFECTION PRET WICH SHALL SHALL DOWT REINFORCEMENT SHALL BE SHACED AT IVIER THESE SHALL BE AND ECONFECTION WOOD TRUSSES IN HIGH SHALL MERS SHALL BE SHACED AT IVIER THESE SHALL BE AND REAS THEN XA IVIER SHALL SHALL SHALL DOWT REINFORCEMENT TO DE SUBJECT AT WILL WITH SERVICES THE THIS SHALL SHALL BE USED FOR ALL MASONRY WORK UNLESS OTHER THE IVIER THESE SHALL BE USED FOR ALL MASONRY WORK UNLESS OTHERWISE B. ROUNDE MOVEMENT TOONTECH AND SHALL SHALL DOWN REAS THEN XA IVIER SHALL SHA	 MINIMUM VERTICAL REINFORCEMENT REQUIREMENTS FOR ALL MASONRY WALLS. A. AS A MINIMUM, ALL MASONRY SHALL BE REINFORCED FER SECTION ACISSO 114222.1 B. AV RETICAL RASS SHALL BE FLACED AT ALL CONNERS, WITHIN 16 I/VERS OF EACH MINIMUM VERTICAL RASS SHALL BE FLACED AT ALL CONNERS, WITHIN 16 I/VERS OF EACH MINIMUM VERTICAL RASS SHALL BE FLACED AT ALL CONNERS, WITHIN 16 I/VERS OF EACH MINIMUM VERTICAL RASS SHALL BE FLACED AT ALL CONNERS, WITHIN 16 I/VERS OF EACH MINIMUM VERTICAL RASS SHALL BE FLACED AT ALL CONNERS, WITHIN 16 I/VERS OF EACH MINIMUM VERTICAL RASS SHALL BE SHACED AT ALL CONNERS, WITHIN 16 I/VERS OF EACH MINIMUM VERTICAL RASS SHALL BE SHACED AT ALL CONNERS, WITHIN 16 I/VERS OF EACH MINIMUM VERTICAL RASS SHALL BE SHACED AT I/VERS OF EACH MINIMUM VERTICAL RASS SHALL BE SHACED AT I/VERS OF EACH MINIMUM VERTICAL RASS SHALL BE SHACED AT I/VERS OF EACH MINIMUM VERTICAL RASS SHALL BE SHACED AT I/VERS OF EACH MINIMUM VERTICAL RASS SHALL BE SHACED OURING REPORTICAL RASS SHALL BE SHACED AT I/VERS OF THE TIMES OF THE INTER SHACE SHALL BE SHACED AT I/VERS OF THE TIMES OF THE INTER SHACE SHALL RESS SHALL BE SHACED OURING REPORTICAL RASS SHALL BE SHACED AT I/VERS OF THE TIMES OF THE INTER SHALE SHALL RESS OF THE TIMES OF THE INTER SHALE SHALL RESS OF THE TIME SHALE S	TO MIX IN FULL BAG QUANTITIES. MEASURE SAND IN BOX WITH VOLUME OF ONE CUBIC FOOT AS OFTEN AS NECESSARY TO MAINTAIN CONSISTENT PROPORTIONS AND AT LEAST ONCE	AN ERECTION PLAN LOCATING ALL TRUSSES SHALL BE PROVIDED. 4. GABLE END WALL FRAMING SHALL BE 2X WOOD STUD FRAMING AS SHOWN ON THE
 A & A & MINIMUM, ALL MASONRY SHALL BE REINFORCED PER SECTION ACI 50 1/1/22.21 B M VERTICAL BARS SHALL BE PLACED AT ALL CORRESS WITHIN 16 INCHES OF EACH WALL OPENINGS. WITHIN 16 INCHES OF EACH WALL DE REINFORCED TOP AND BINTON OF OPENINGS. C HORDZYNIAL JONT REINFORCED TOP AND BITTON OF OPENINGS. SHALL DE REINFORCED TOP AND BITTON OF OPENINGS. AND SHALL EXTEND NOT LESS THAW 31 INCHES OF THE WALL NOT SKEED AT 16 MAX. WALL DEPNINGS SHALL DE REINFORCED TOP AND BITTON OF OPENINGS. SHALL DE REINFORCED TOP AND BITTON OF OPENINGS. AND SHALL EXTEND NOT LESS THAW 31 INCHES DETTON HORDER. THE SHALL NOT EXCEED 4-0" D. SPACING OF VERTICAL REINFORCEMENT SHALL NOT EXCEED 4-0" D. SPACING OF VERTICAL REINFORCEMENT SHALL NOT EXCEED 4-0" D. SPACING OF VERTICAL REINFORCEMENT SHALL NOT EXCEED 4-0" ROUNDE PREFABRICATED 1" AND T" SHAPPED HORIZOTTAL JOINT REINFORCEMENT SHALL NOT EXCEED 4-0" D. SPACING OF VERTICAL REINFORCEMENT SHALL NOT EXCEED 4-0" D. SPACING OF VERTICAL REINFORCEMENT SHALL NOT EXCEED 4-0" D. SPACING OF VERTICAL REINFORCEMENT SHALL NOT EXCEED 4-0" D. SPACING OF VERTICAL REINFORCEMENT SHALL NOT EXCEED 4-0" N. TIRESSE STALL BE USED FOR ALL MASONRY WORK UNLESS OTHERWISE N. ONOTED OTHERWISE. N. RUNNING BOARDE TIES SHALL BE USED FOR ALL MASONRY WORK UNLESS OTHERWISE N. MORE DOTTING ADD BY A BENETICED NOT AND SHALL PERVISE PROVIDE MUCH MATTER SHALL DE USED FOR ALL MASONRY WORK UNLESS OTHERWISE. N. MORE DOTTING ADD BERARDE LOW WORK UNLESS OTHERWISE. N. MORE DOTTING ADD BERARDE LOW WORK UNLESS OTHERWISE. N. MORE DOTTING ADD BERARDE LOW WORK UNLESS OTHERWISE. PROVIDE MUCH MORE TOR SHALL DE USED FOR ALL MASONRY WORK UNLESS OTHERWISE. N. MORE D	 A & A & MINIMUM, ALL MASONRY SHALL BE REINFORCED PER SECTION ACI 50: 114:22:1 REQUIREMENTS HEW WICK STANDARDS, "THIS BAYCING AND SATERIAL SHALL SE SUPPLIED REQUIREMENTS HEW WICK STANDARDS," THIS BAYCING AND SATERIAL SHALL SE SUPPLIED WICKES OF THE WOLL CORRESS, WITHIN 16 INCHES OF EACH WILL DEFENSION MULTING INCHES OF EACH WILL DEFENSION MULTING INCHES OF EACH WILL DEFENSION THIS IN AULT. CORRESS, WITHIN 16 INCHES OF EACH WILL DEFENSION THIS IN AULT. CORRESS OF THE WOLL THIS IN A BAYCING AND SHALL EXTERD INTIN 8 SHALL DEFENSION THIS INTO THE WILL MULTING SATER AND SHALL EXTERD INTIN 8 SHALL DEFENSION THIS INTO THE WILL MULTING SATER AND SHALL EXTERD INTO LESS SHALL DEFENSION THIS INTO AND THE SHALL DOT PAND BATCHING AND SHALL EXTERD INTO LESS THAN AU INCHES SHALL DE FENSION THE INTO THE INTO THE INTO THE INTO THE WILL WILL SHALL WILL SHALL SHAL		USED AS AN ALTERNATE TO THIS FRAMED GABLE WALL PROVIDED THAT THE MANUFACTURE
 B. AV VERTICAL BAS SHALL BE PLACED AT ALL CORNERS, WITHIN 16 NOKES OF EACH WALL DOPINIOS INTERNISTS INTERNISTS OF THE WALL. C. HORIZONTAL JOINT REINFORCEMENT SHALL BE SPACED AT 16 MAX. WALL OPENINGS SHALL BE REINFORCED TOP AND BOTTOM OF OPENINGS AND SHALL EXTEND NOT LESS SHALL BE REINFORCED TOP AND BOTTOM OF OPENINGS AND SHALL EXTEND NOT LESS SHALL BE REINFORCED TOP AND BOTTOM OF OPENINGS AND SHALL EXTEND NOT LESS SHALL BE REINFORCED TOP AND BOTTOM OF OPENINGS AND SHALL EXTEND NOT LESS SHALL BE REINFORCED TOP AND BOTTOM OF OPENINGS AND SHALL EXTEND NOT LESS SHALL BE REINFORCED TOP AND BOTTOM OF OPENINGS AND SHALL EXTEND NOT LESS SHALL BE REINFORCED TOP AND DOTTOM OF OPENINGS AND SHALL EXTEND NOT LESS SHALL BE REINFORCED TOP AND TO SHALT BE REINFORCEMENT SHALL NOT EXCEED 4-0'. C. HORIZONES ALL TRANSE SHALL DOTTOM OF DESTING. D. SPACING OF VERTICAL REINFORCEMENT SHALL NOT EXCEED 4-0'. RONDE PREVENTION FROM TO CONSTRUCTION. RONDE DRANK SHIT IES REINFORCEMENT TO SHALL SUBMITTE OOR REINFORCEMENT TO BE SUBMITTED OOR REVIEW CONSIDERATION FROM TO CONSTRUCTION. RONNING BOND PATTERN SHALL BE USED FOR ALL MASONRY WORK UNLESS OTHERWISE NOTED. PROVIDE INVELENT TO CONSTRUCTION. RONNING BOND PATTERN SHALL BE USED FOR ALL ALL SUBMITTE OOR REVIEW CONSIDERATION FROM TO CONSTRUCTION. RONNING BOND PATTERN SHALL BE USED FOR ALL ALL SUBMIT CONTINUES ACROSS MOVEMENT JOINTS IN LESS STOTED OTHERWISES RONDE BUNCHNSS INCOM JOINTS IN WALLS WHERE INDICATED ON ARCHITECTURAL DEVENTIONS INCOMPRESS MOVEMENT TO CONDINATE WITH PERMIT CONTINGENCIES. U. MUESS SONED DETAK SHALL BE USED FOR ALL SUBDIC CONTINUUS ACROSS MOVEMENT TO CONDINATE WITH PERMIT CONTINGENCIES. U. DUESS NOTED OTHERWISES MINUM BELONG ALL SUBMIT CONTINGENCIES. U. DUESS NOTED OTHERWISES MINUM BELONG ALL DOR DATERS SHALL BE BURCHN AND ORNE REAR BUNCH TO CONTINUE ACROSS MOVEMENT TO CONDINATE WITH PERMIT CONTINGENCIES. U. DUESS NOTED OTHERWISES MINUM	 B. A VERTICAL BAS SHALL BE PLACED AT ALL CONNERS. WITHIN 16 NCHES OF EACH WALL DEPINIOS. WITHIN IS INCHES OF EACH WALL MOCENNES. C. HORIZONTAL JOINT REINFORCEMENT SHALL BE SPACED AT 16" MAX. WALL OPENINGS SHALL BE REINFORCED TOP AND BOTTOM OF OPENINGS. AND SHALL EXTEND NOT LESS SHALL BE REINFORCED TOP AND BOTTOM OF OPENINGS. D. SPACING OF VERTICAL REINFORCEMENT SHALL NOT EXCEED 4-0". C. HORIZONTAL JOINT REINFORCEMENT SHALL NOT EXCEED 4-0". C. BORIZON D'AST THE ROUTON D'EXTERT. AND TS HARDED TOR ALD SUBMITED ON REVIEW WALL D'EXTERNAL SHALL BE USED FOR ALL MASONRY WORK UNLESS OTHERWISE NOTED. PROVIDE PREFABRICATED 'L' AND 'T SHAPED HORIZONTAL JOINT REINFORCING AT WALL INTERSECTION. ALTIGNATE MENT SHALL NOT EXCEED 4-0". C. HORIZONTAL JOINT REINFORCEMENT SHALL NOT EXCEED 4-0". R. RUNNING BOND PATTERN SHALL BE USED FOR ALL MASONRY WORK UNLESS OTHERWISE NOTED. PROVIDE PREFABRICATED 'L' AND 'T SHAPED HORIZONTAL JOINT REINFORCING AT WALL INTERSECTION. ALTIGNATE MENT TO CONSTRUCTION. R. RUNNING BOND PATTERN SHALL BE USED FOR ALL MASONRY WORK UNLESS OTHERWISE NOTED. PROVIDE NOVEMENT ICONTROL AND EXAMISSION JOINTS IN WALLS WHERE INDICATED ON ARCHITECTURAL DEVENTION. J. BARDING SOND BEARS SHALL BE USED FOR ALL BEARING ADJACENT TO CONDITIST IN CONCRETE BLOCK SASH BLOCK UNTI WITH PREFORMED SHEAR ACCEPTABLE - SUBMIT DETAILS FOR ACONTROL JOINTS IN WALLS WHERE ENDICATED ON ARCHITECTURAL DEVENTIONS SINCE BARRING PLATES, BEARING PLATES, BEARING ADJACENT TO CONDITIST IN CONCRETE BLOCK SASH BLOCK UNTI WITH REFORMED SHEAR ACCEPTABLE - SUBMIT DETAILS FOR ACONTROL JOINTS IN WALLS WHERE ENDICATED ON ARCHITECTURAL DEVENTIONS FOR AREA BLOCK UNTI WITH REFORMED SHEAR ACCEPTABLE - SUBMIT DETAILS FOR ALL BE SUBDROCK DATES AND CONTROL THAS FOR ADRESS SINCE DIAGNES SMOULEME BEARING ADJACENT TO CONTROL BULLING PARER BOND BREAK BELOW LINTELS BEARING PLATES, BEARING PLATES, BEARING PLATES, BEARING PLATES, BEARING PLATES, BEARING PLATES, BEA		REQUIREMENTS PER WTCA STANDARDS. THIS BRACING AND MATERIAL SHALL BE SUPPLIED
 INCIDES OF THE END OF THE WALL INCIDES OF THE END OF THE SHALL BE SPACED AT 16* MAX. WALL OPENINGS SHALL BE ENERGENEES TO PAND EDTTOM OF OPENINGS AND SHALL ESTEND NOT LESS SHALL BE ENERGENEES END OP AND EDTOM OF OPENINGS AND SHALL ESTEND NOT LESS SHALL BE ENERGENEES END OP AND EDTOM OF OPENINGS. INCIDES END OF AND EDTOM OF OPENINGS AND SHALL ESTEND NOT LESS SHALL BE ENERGENEES END ON PAST THE ENDOM OF ENNIO. INCIDES END OF AND EDTOM OF OPENINGS AND SHALL ESTEND NOT LESS SHALL BE ENERGENEES END ON PAST THE END OF OPENINGS AND SHALL ESTEND NOT RESERVEES INCIDES ENT OF THE MALE DE USED FOR ALL MADON EXCIDENT OF OR REVIEW CONSIDERATION FRICT TO CONSTRUCTION. INCIDES OF THE END OF END OF OR END PAST THE ROUTE OF OR REVIEW CONSIDERATION FRICT TO CONSTRUCTION. INCIDES OF THE REVIEW BOTTOM CHORD BRACES OF END OF OR ALL MADON END FRACES. INCIDES OF THE REVIEW BOTTOM CHORD BRACES OF STANPED ERECTION /SHOP DRAWINGS OF THE PRE-ENDINESTRUCTION. INCIDES OF ON ALL MADON EXPRANSION, JOINTS IN WALLS WHERE INDICATED ON ACCUTETURAL DRAWINGS BOD PATTERN SHALL BE USED FOR ALL MADON WORK UNLESS OTHERWISE ACCORDINATE WITH PERMIT CONTROL AND EXPANSION, JOINTS IN WALLS WHERE INDICATED ON ACCUTETURAL DRAWINGS BOD PARTERN SHALL BE DESCONTINUOUS ACROSS MOVEMENT JOINTS UNLESS NOTED OTHERWISE ON PLANS, UNDER LINTEL, BEARING ALL DE MARKED ALL BE DESCONTINUOUS ACROSS MOVEMENT JOINTS UNLESS STATE END OF HEAR REVIEW BOTTS IN WALLS WHERE INDICATED ON ACCUTETURAL DRAWINGS BOD PARTERN SHALL BE DESCONTINUOUS ACROSS MOVEMENT JOINTS UNLESS NOTED OTHERWISE ON PLANS, UNDER LINTELS, BEARING, ETC.; FILL CELLS WITH PERMIT CONTINUES BANG MAD BEARS AND EARL BE DESCONTINUOUS ACROSS MOVEMENT JOINTS UNLESS NOTED OTHERWISE ON PLANS, RANGING AD PARTERN ADAM PARTERN ADAM PART	 INCIDES OF THE END OF THE WALL INCIDES OF THE END OF AND ENT OF AND ENTALL BE SPACED AT 16" MAX. WALL OPENINGS SHALL BE ENERVORCES ENTOND PAST THE END OF OPENINGS AND SHALL EXTEND NOT LESS INCIDES ENTOND PAST THE END OF OPENINGS. INCIDES ENTOND OF VERTICAL REINFORCEMENT SHALL NOT EXCED 4"0" INCIDES ENTONE OF VERTICAL REINFORCEMENT SHALL NOT EXCED 4"0" INCIDES ENTON OF VERTICAL REINFORCEMENT SHALL NOT EXCED 4"0" INTERSECTIONS. ALTERNATE MESH TIES REINFORCEMENT TO ES SUBJITTED FOR REVIEW INTERSECTIONS. ALTERNATE MESH TIES REINFORCEMENT TO ES SUBJITTED FOR REVIEW INTERSE OF THE ROUTE OF THE ROUTE OF ALL MASONRY WORK UNLESS OTHERWISE INTOTED. INTOTED. AND EXPANSION JOINTS IN WALLS WHERE INDICATED ON REVIEW INTORES INTERTION CONTROL CONTROL AND EXPANSION JOINTS IN WALLS WHERE INDICATED ON REVIEW INTERSE OTTON TO ROUTE BLOCK: SASH BLOCK UNIT WITH PREFORMED SHEAR REVIEW INTOTED. INTERSE OTTON TO ROUTE BLOCK: SASH BLOCK UNIT WITH PREFORMED SHEAR REVIEW INTERSE OTTON TO ROUTE BLOCK: SASH BLOCK UNIT WITH PREFORMED SHEAR REVIEW INTOTED. INTERSE OTTON TO ROUTE BLOCK: SASH BLOCK UNIT WITH PREFORMED SHEAR REVIEW INTERSE OTTON TO ROUTE BLOCK: SASH BLOCK UNIT WITH PREFORMED SHEAR REVIEW INTERSE OTTON TO ROUTE BLOCK: SASH BLOCK UNIT WITH PREFORMED SHEAR REVIEW INTERSE OTTON SHALL SUBPORTE AND REVIEW SERVICE. INTERSE OTTON TO ROUTE BLOCK INTEL JOINTS MAY BE ACCES FOR ALL BED INFORMED SHALL BE EXPRICE AND AND MERINE AND REVIEW SERVICE. INTERSE TO THERWISE ON PLANS,		
 THAN 24 INCHES BEYOND PAST THE ROUCH OPENING. D. SPACING OF VERTICAL REINFORCEMENT SHALL NOT EXCEED 4-0° S. SPACING OF VERTICAL REINFORCEMENT SHALL NOT EXCEED 4-0° PROVIDE PREPARIACITED 1', SHAPED HORIZONTAL, JOINT REINFORCING AT WALL INTERSECTIONS, ALTERNATE MESH TIES REINFORCEMENT TO BE SUBMITTED FOR REVEW CONSIDERATION PRIOR TO CONSTRUCTION. R. RUNNING BOND PATTERN SHALL BE USED FOR ALL MASONRY WORK UNLESS OTHERWISE NOTED. PROVIDE MOVIDE MOVEMENT (CONTROL ADD EXPANSION) JOINTS IN VALS WHERE IDICATED ON ARCHITECTURAL DRAWINGS. BOND BARANS SHALL BE DISCONTINUOUS ACROSS MOVEMENT JOINTS UNLESS NOTED OTHERWISE. PROVIDE MOVIDE MOVEMENT (CONTROL ADD EXPANSION) JOINTS IN WALS WHERE IDICATED ON ACCEPTABLE - SUBMIT DETAILS FOR CONTROL JOINTS MAY BE ACCEPTABLE - SUBMIT DETAILS FOR CONTROL JOINTS MAY BE ACCEPTABLE - SUBMIT DETAILS FOR CONTROL JOINTS MAY BE ACCEPTABLE - SUBMIT BETALLS FOR CONTROL JOINTS MAY BE ACCEPTABLE - SUBMIT BETALLS FOR RELIVED AND BREAK BELOK UNIT WITH PREFORMED SHEAR KEY, CAULK BOTH FRACES. MINIMUM SELOW BEARING, DAJACENT TO CONTROL JOINTS. UNLESS NOTED OTHERWISE ON PLANS, UNDER LINTEL BEARING ADJACENT TO CONTROL JOINTS. UNLESS NOTED OTHERWISE ON PLANS, UNDER LINTEL BEARING ADJACENT TO CONTROL JOINTS. UNLESS NOTED OTHERWISE ON PLANS, UNDER LINTEL, BEARING ADJACENT TO CONTROL JOINTS. UNLESS NOTED OTHERWISE ON PLANS, UNDER LINTELS, BEAMS, ETC.; FILL COLCATED AT 182 BAR JOINTERS MANUMUM SELOW BEARING. HARLIFTERS MANUMUM SELOW BEARING. HARLIFTERS MANUMUM SECON DRATERS MANUMUM OF TWO POSITIONERS PER GROUT POUR (ONR NEAR THE BOTTOM AND ONE NEAR THE TOP) TO PREVENT DURING THE PLANCHTER MANUMUM SELOW BEARING. 	 THAN 24 INCHES BEYOND PAST THE ROUCH OPENING. D. SPACING OF VERTICAL REINFORCEMENT SHALL NOT EXCEED 4-0° SPACING OF VERTICAL REINFORCEMENT SHALL NOT EXCEED 4-0° PROVIDE PREPARINCATED 1, 'AND 'T SHAPED HORIZONTAL JOINT REINFORCING AT WALL INTERSECTIONS. ALTERNATE MESH TIES REINFORCEMENT TO BE SUBMITTED FOR REVIEW CONSIDERATION PRIOR TO CONSTRUCTION. RUNNING BOND PATTERN SHALL BE USED FOR ALL MASONRY WORK UNLESS OTHERWISE NOTED. PROVIDE MOVIDE MOLTRIC DAD EXPANSION JOINTS IN WALLS WORK UNLESS OTHERWISE NOTED. PROVIDE MOVIDE MOLTRIC DAD EXPANSION JOINTS IN WALLS WORK UNLESS OTHERWISE NOTED. PROVIDE MOVIDE MOLTRIC DAD EXPANSION JOINTS IN WALLS WORK UNLESS OTHERWISE NOTED. PROVIDE MOVIDE MOLTRIC DAD EXPANSION JOINTS IN WALLS WORK UNLESS OTHERWISE ACCEPTABLE - SUBMIT CONTROL AND EXPANSION JOINTS IN WALLS WORK UNLESS OTHERWISE ACCEPTABLE - SUBMIT DETAILS FOR CONTROL JOINTS MALL BE DEFOR ALL MASONRY WORK UNLESS OTHERWISE ACCEPTABLE - SUBMIT DETAILS FOR CONTROL JOINTS MALLS WERE REJICATED ON ACCEPTABLE - SUBMIT DETAILS FOR CONTROL JOINTS MAY BE ACCEPTABLE - SUBMIT DETAILS FOR APPROVAL. I. PROVIDE BUILDING PAPER BOND BREAK BELOK UNIT WITH PREFORMED SHEAR KEY, CAULK BOTH FACES. ANTERN SHALLS FOR APPROVAL. I. PROVIDE BUILDING PAPER BOND BREAK BELOK UNITEL BEARING ADJACENT TO CONTROL JOINTS. I. ALL REINFORCING PAPER SOND BREAK BELOK UNITEL BEARING ADJACENT TO POSITIONERS PER GROUT POUR JONR FERS MAXIMUM BELOK BEARING. I. ALL REINFORCING SHELS SMAINTERS MAXIMUM POT YON POSITIONERS PER GROUT POUR JONR NEAR THE DOTTO AND ONE NEAR THE TOP TO POSITIONERS PER GROUT POUR JONR NEAR THE BOTTOM AND ONE NEAR THE TOP TO POSITIONERS PER GROUT POUR JONR NEAR THE BOTTOM AND ONE NEAR THE TOP TO POSITIONERS PER GROU	INCHES OF THE END OF THE WALL. C. HORIZONTAL JOINT REINFORCEMENT SHALL BE SPACED AT 16" MAX . WALL OPENINGS	RECOMMENDATIONS FOR HANDLING, INSTALLING AND BRACING METAL PLATE CONNECTED WOOD TRUSSES, HIB-91" BY THE TRUSS PLATE INSTITUTE, UNLESS MORE STRICT BRACING IS
 7. PROVIDE PREFABRICATED "L" AND "T" SHAPED HORIZONTAL JOINT REINFORCING AT WALL INTERSECTIONS. ALTERNATE MESH TIES REINFORCEMENT TO BE SUBMITTED FOR REVIEW CONSIDERATION FRIGAT CONSTRUCTION. 8. PUNING BOND PATTERN SHALL BE USED FOR ALL MASONRY WORK UNLESS OTHERWISE NOTED. 9. PROVIDE MOVEMENT (CONTROL AND EXPANSION) JOINTS IN WALLS WHERE INDICATED ON ARCHTECTURAL DRAWINGS. BOND BEAKS SHALL BE DISCONTINUOUS ACROSS MOVEMENT JOINTS UNLESS NOTED OTHERWISE: 4. MOVEMENT JOINTS IN CONCRETE BLOCK: SASH BLOCK UNIT WITH PREFORMED SHEAR KEY. CAULK BOTH FACES. ALTERNATE DETAILS FOR CONTROL JOINTS MAY BE ACCEPTABLE - SUBMIT DETAILS FOR APPROVAL. 8. PROVIDE BUILDING PAPER BOND BREAK BELOW LINTEL BEARING ADJACENT TO CONTROL JOINTS. 10. UNLESS NOTED OTHERWISE ON PLANS, UNDER UNITELS, BEARING PLATES, BEARING, ETC.; FILL CELLS WITH GROUT, 3 COURSES MINIMUM BELOW BEARING. 11. ALL REINFORCING STEEL SHALL BE SUPPORTED AND FASTEMED TO APPROVED POSITIORRS LOCATED STEEL SHALL BE SUPPORTED AND FASTEMED TO APPROVED POSITIORRS LOCATED JURING WING STEEL SHALL BE SUPPORTED AND FASTEMED TO APPROVED POSITIORRS LOCATED JURING WING PARTER BONT DURN THE FERS MAXIMUM SPACING ADJURT TO TO PROVIDE BUILDING PARE BONT DURN THE FERS MAXIMUM SPACING ADJURT TO TO APPROVED POSITIORRS LOCATED JURING WING PARTER BONT DURN THE PROFERS MAXIMUM SPACING ADJURTE TO APPROVED POSITIORRS LOCATED JURING WING AND FERS MAXIMUM SPACING ADJURT TO APPROVED POSITIORRS LOCATED JURING WING PARTER SMAXIMUM SPACING ADJURT AN INFORM OF TWO POSITIONERS PER GROUT POUR (ONE NEAR THE BOTTOM AND ONE NEAR THE TOP) TO PREVENT DURN THE TERNES FOR DURN THE MENFORCING BARS MUST 	 7. PROVIDE PREFABRICATED 'L' AND T' SHAPED HORIZONTAL JOINT REINFORCING AT WALL INTERSECTIONS. ALTERNATE MESH TIES REINFORCEMENT TO BE SUBMITTED FOR REVIEW CONSIDERATION FRIGATE OCONSTRUCTION. 8. PROVIDE BOND PATTERN SHALL BE USED FOR ALL MASONRY WORK UNLESS OTHERWISE NOTED. 9. PROVIDE MOVEMENT (CONTROL AND EXPANSION) JOINTS IN WALLS WHERE INDICATED ON ARCHTECTURAL DRAWINGS. BOND BEANS SHALL BE DISCONTINUOUS ACROSS MOVEMENT JOINTS UNLESS NOTED OTHERWISE: 4. MOVEMENT JOINTS IN CONCRETE BLOCK: SASH BLOCK UNIT WITH PREFORMED SHEAR KEY. CAULK BOTH FACES. ALTERNATE DETAILS FOR CONTROL JOINTS MAY BE ACCEPTABLE - SUBMIT DETAILS FOR APPROVAL. 8. PROVIDE BUILDING PAPER BOND BREAK BELOW LINTEL BEARING AJACENT TO CONTROL JOINTS. 10. UNLESS NOTED OTHERWISE ON PLANS, UNDER UNITELS, BEARING PLATES, BEARING, ETC.; FILL CELLS WITH GROUT, 3 COURSES MINIMUM BELOW BEARING. 11. ALL REINFORCING STEEL SHALL BE SUPPORTED AND FASTEMED TO APPROVED POSITIONERS LOCATED STITUATER SMARLM SPACING ADD WITH A NINIMUM OF TWO POSITIONERS PER GROUT POUR (ONE NEAR THE BOTTOM AND ONE NEAR THE TOP) TO PREVENT DURING THE RESTRUCTED RESTRUCTION AND ONE NEAR THE TOP) TO PREVENT DURING THE RESTRUCTION SPACES MAND STICE SUPPLICEMENT FOR SPACE STRUCT POUR (ONE NEAR THE BOTTOM AND ONE NEAR THE TOP) TO PREVENT DURING THE PREFORMANT MAY SPACE ACCEPTABLE - SUPPRIVERS MANUM SPACING ADD REAR THE TOP) TO PREVENT DURING THE PREFORMANT MAND SPACING ADD REAR THE TOP) TO PREVENT DURING THE PREFORMANT MAND SPACING ADD STICH RERS PROVIDE BUILDING THE RESTRUCTION SPACES MAND SPACES MAND SPACES MAND SPACES ADD STANCES MAND SPACES MAND SPACES ADD STICH RERS PROVIDE BUILDING THE STANCE DO THE REPORTED AND FASTEMENT OF APPROVED POSITIONERS LOCATED AT THE REPORTED STRUCT AND FASTEMENT OF APPROVED POSITIONERS PROVENT DURING THE PROVIDER SPACE MENT DURING THE PORTED AND FASTEMENT TO POPOSITIONERS PROVENT DURING THE PROVIDER SPACE MENT DURING THE PROFORMOUS BARS MUST 	THAN 24 INCHES BEYOND PAST THE ROUGH OPENING.	CHORD IS LATERALLY BRACED BY PLYWOOD SHEATHING.
 R RUNNING BOND PATTERN SHALL BE USED FOR ALL MASONRY WORK UNLESS OTHERWISE NOTED. PROVIDE MOVEMENT (CONTROL AND EXPANSION) JOINTS IN WALLS WHERE INDICATED ON ARCHITECTURAL DRAWINGS. BOND BEAMS SHALL BE DISCONTINUOUS ACROSS MOVEMENT JOINTS UNLESS NOTED OTHERWISE: A. MOVEMENT JOINTS IN CONCRETE BLOCK: SASH BLOCK UNIT WITH PREFORMED SHEAR KEY, CAULK BOTH FACES, ALTERNATE DETAILS FOR CONTROL JOINTS MAY BE ACCEPTABLE – SUBMIT DETAILS FOR APPROVAL. PROVIDE BUILDING PAPER BOND BREAK BELOW LINTEL BEARING ADJACENT TO CONTROL JOINTS. UNLESS NOTED OTHERWISE: ON PLANS, UNDER LINTELS, BEARING PLATES, BEAMS, ETC.; FILL CELLS WITH GROUT, 3 COURSES MINIMUM BELOW BEARING. UNLESS NOTED OTHERWISE ON PLANS, UNDER LINTELS, BEARING, ETC.; FILL CELLS WITH GROUT, 3 COURSES MINIMUM BELOW BEARING. ALREINFORCING STEEL SHALL BE SUPPORTED AND FASTENED TO APPROVED POSITIONERS LOCATED AT 192 BAR DIMETERS MAXIMUM SPACING SAW WINHING OF TWO POSITIONERS PER GROUT POUR (ONE NEAR THE DOTT TWO POSITIONERS PER GROUT POUR (ONE NEAR THE BOTTOM AND ONE NEAR THE TOP) TO POSITIONERS PER GROUT POUR (ONE NEAR THE BOTTOM AND ONE NEAR THE TOP) TO PREVENT DURING THE PLACEMENT OF GROUT. ALL REINFORCING BARS MUST 	 R RUNNING BOND PATTERN SHALL BE USED FOR ALL MASONRY WORK UNLESS OTHERWISE NOTED. PROVIDE MOVEMENT (CONTROL AND EXPANSION) JOINTS IN WALLS WHERE INDICATED ON ARCHITECTURAL DRAWINGS. BOND BEAMS SHALL BE DISCONTINUOUS ACROSS MOVEMENT JOINTS UNLESS NOTED OTHERWISE: A. MOVEMENT JOINTS IN CONCRETE BLOCK: SASH BLOCK UNIT WITH PREFORMED SHEAR KEY, CAULK BOTH FACES, ALTERNATE DETAILS FOR CONTROL JOINTS MAY BE ACCEPTABLE – SUBMIT DETAILS FOR APPROVAL. PROVIDE BUILDING PAPER BOND BREAK BELOW LINTEL BEARING ADJACENT TO CONTROL JOINTS. UNLESS NOTED OTHERWISE: ON PLANS, UNDER LINTELS, BEARING PLATES, BEAMS, ETC.; FILL CELLS WITH GROUT, 3 COURSES MINIMUM BELOW BEARING. UNLESS NOTED OTHERWISE ON PLANS, UNDER LINTELS, BEARING, ETC.; FILL CELLS WITH GROUT, 3 COURSES MINIMUM BELOW BEARING. ALREINFORCING STEEL SHALL BE SUPPORTED AND PARTISCH D TO APPROVED POSITIONERS LOCATED AT 192 BAR DIMMETERS MAXIMUM SPACING SAD WITH AND ONE NEAR THE TOP) TO PREVENT DURING THE PLACEMENT OUR GROUT. ALL REINFORCING BARS MUST 	 PROVIDE PREFABRICATED "L" AND "T" SHAPED HORIZONTAL JOINT REINFORCING AT WALL INTERSECTIONS. ALTERNATE MESH TIES REINFORCEMENT TO BE SUBMITTED FOR REVIEW 	EQUAL TO THE SPACING BETWEEN BOTTOM CHORD BRACES. BOTTOM CHORD BRACES SHALL BE SUPPLIED BY TRUSS MANUFACTURER.
 9. PROVIDE MOVEMENT (CONTROL AND EXPANSION) JOINTS IN WALLS WHERE INDICATED ON ARCHITECTURAL DRAWINGS. BOND BEAMS SHALL BE DISCONTINUOUS ACROSS MOVEMENT JOINTS UNLESS NOTED OTHERWISE: A. MOVEMENT JOINTS IN CONCRETE BLOCK: SASH BLOCK UNIT WITH PREFORMED SHEAR KEY: CAULK BOTH FACES. ALTERNATE DETAILS FOR CONTROL JOINTS MAY BE ACCEPTABLE SUBMIT DETAILS FOR APPROVAL. B. PROVIDE BUILDING PAPER BOND BREAK BELOW LINTEL BEARING ADJACENT TO CONTROL JOINTS. 10. UNLESS NOTED OTHERWISE ON PLANS, UNDER LINTELS, BEARING PLATES, BEAMS, ETC.; FILL CELLS WITH GROUT, 3 COURSES MINIMUM BELOW BEARING. 11. ALL REINFORCING STEEL SHALL BE SUPPORTED AND FASTENED TO APPROVED POSITIONERS LOCATED AT 192 BAR DIAMETERS MAXIMUM SPACING AND WITH A MINIMUM OF TWO POSITIONERS PER GROUT POUR (ONE NEAR THE BOT) TO PREVENT DURING THE PLACEMENT OF GROUT OR ONE AND THE BOTTOR BARS MUST 	 9. PROVIDE MOVEMENT (CONTROL AND EXPANSION) JOINTS IN WALLS WHERE INDICATED ON ARCHITECTURAL DRAWINGS. BOND BEAMS SHALL BE DISCONTINUOUS ACROSS MOVEMENT JOINTS UNLESS NOTED OTHERWISE: A. MOVEMENT JOINTS IN CONCRETE BLOCK: SASH BLOCK UNIT WITH PREFORMED SHEAR KEY: CAULK BOTH FACES. ALTERNATE DETAILS FOR CONTROL JOINTS MAY BE ACCEPTABLE SUBMIT DETAILS FOR APPROVAL. B. PROVIDE BUILDING PAPER BOND BREAK BELOW LINTEL BEARING ADJACENT TO CONTROL JOINTS. 10. UNLESS NOTED OTHERWISE ON PLANS, UNDER LINTELS, BEARING PLATES, BEAMS, ETC.; FILL CELLS WITH GROUT, 3 COURSES MINIMUM BELOW BEARING. 11. ALL REINFORCING STEEL SHALL BE SUPPORTED AND FASTENED TO APPROVED POSITIONERS LOCATED AT 192 BAR DIAMETERS MAXIMUM SPACING AND WITH A MINIMUM OF TWO POSITIONERS PER GROUT POUR (ONE NEAR THE TOP) TO PREVENT DURING THE PLACEMENT OF GROUT OR ONE ART THE BOTTOR AND ONE AND ONE NEAR THE BOTTOP TO PREVENT DURING THE PLACEMENT OF GROUT OR MAN DONE NEAR THE TOP) TO PREVENT DURING THE PLACEMENT OF GROUT FOR CINCING BARS MUST 	8. RUNNING BOND PATTERN SHALL BE USED FOR ALL MASONRY WORK UNLESS OTHERWISE	/ SHOP DRAWINGS OF THE PRE-FABRICATED WOOD TRUSSES TO THE BUILDING OFFICIAL.
 A. MOVEMENT JOINTS IN CONCRETE BLOCK: SASH BLOCK UNIT WITH PREFORMED SHEAR KEY, CAULK BOTH FACES. ALTERNATE DETAILS FOR CONTROL JOINTS MAY BE ACCEPTABLE SUBMIT DETAILS FOR APPROVAL. B. PROVIDE BUILDING PAPER BOND BREAK BELOW LINTEL BEARING ADJACENT TO CONTROL JOINTS. 10. UNLESS NOTED OTHERWISE ON PLANS, UNDER LINTELS, BEARING PLATES, BEAMS, ETC.; FILL CELLS WITH GROUT, 3 COURSES MINIMUM BELOW BEARING. 11. ALL REINFORCING STEEL SHALL BE SUPPORTED AND FASTENED TO APPROVED POSITIONERS LOCATED AT 192 BAR DIAMETERS MAXIMUM SPACING AND WITH A MINIMUM OF TWO POSITIONERS PER GROUT POUR (ONE NEAR THE BOTTOM AND ONE NEAR THE TOP) TO PREVENT DISPLACEMENT DURING THE PLACEMENT OF GROUT. ALL REINFORCING BARS MUST 	 A. MOVEMENT JOINTS IN CONCRETE BLOCK: SASH BLOCK UNIT WITH PREFORMED SHEAR KEY. CAULK BOTH FACES. ALTERNATE DETAILS FOR CONTROL JOINTS MAY BE ACCEPTABLE SUBMIT DETAILS FOR APPROVAL. B. PROVIDE BUILDING PAPER BOND BREAK BELOW LINTEL BEARING ADJACENT TO CONTROL JOINTS. 10. UNLESS NOTED OTHERWISE ON PLANS, UNDER LINTELS, BEARING PLATES, BEAMS, ETC.; FILL CELLS WITH GROUT, 3 COURSES MINIMUM BELOW BEARING. 11. ALL REINFORCING STEEL SHALL BE SUPPORTED AND FASTENED TO APPROVED POSITIONERS LOCATED AT 192 BAR DIAMETERS MAXIMUM SPACING AND WITH A MINIMUM OF TWO POSITIONERS PER GROUT POUR (ONE NEAR THE BOTTOM AND ONE NEAR THE TOP) TO PREVENT DISPLACEMENT DURING THE PLACEMENT OF GROUT. ALL REINFORCING BARS MUST 	ARCHITECTURAL DRAWINGS. BOND BEAMS SHALL BE DISCONTINUOUS ACROSS MOVEMENT	
 B. PROVIDE BUILDING PAPER BOND BREAK BELOW LINTEL BEARING ADJACENT TO CONTROL JOINTS. 10. UNLESS NOTED OTHERWISE ON PLANS, UNDER LINTELS, BEARING PLATES, BEAMS, ETC.; FILL CELLS WITH GROUT, 3 COURSES MINIMUM BELOW BEARING. 11. ALL REINFORCING STEEL SHALL BE SUPPORTED AND FASTENED TO APPROVED POSITIONERS LOCATED AT 192 BAR DIAMETERS MAXIMUM SPACING AND WITH A MINIMUM OF TWO POSITIONERS PER GROUT POUR (ONE NEAR THE BOTTOM AND ONE NEAR THE TOP) TO POSITIONERS PER GROUT DURING THE PLACEMENT OF GROUT. ALL REINFORCING BARS MUST 	 B. PROVIDE BUILDING PAPER BOND BREAK BELOW LINTEL BEARING ADJACENT TO CONTROL JOINTS. 10. UNLESS NOTED OTHERWISE ON PLANS, UNDER LINTELS, BEARING PLATES, BEAMS, ETC.; FILL CELLS WITH GROUT, 3 COURSES MINIMUM BELOW BEARING. 11. ALL REINFORCING STEEL SHALL BE SUPPORTED AND FASTENED TO APPROVED POSITIONERS LOCATED AT 192 BAR DIAMETERS MAXIMUM SPACING AND WITH A MINIMUM OF TWO POSITIONERS PER GROUT POUR (ONE NEAR THE BOTTOM AND ONE NEAR THE TOP) TO POSITIONERS PER GROUT POURING THE PLACEMENT OF GROUT. ALL REINFORCING BARS MUST 	A. MOVEMENT JOINTS IN CONCRETE BLOCK: SASH BLOCK UNIT WITH PREFORMED SHEAR KEY. CAULK BOTH FACES. ALTERNATE DETAILS FOR CONTROL JOINTS MAY BE	
 UNLESS NOTED OTHERWISE ON PLANS, UNDER LINTELS, BEARING PLATES, BEAMS, ETC.; FILL CELLS WITH GROUT, 3 COURSES MINIMUM BELOW BEARING. ALL REINFORCING STEEL SHALL BE SUPPORTED AND FASTENED TO APPROVED POSITIONERS LOCATED AT 192 BAR DIAMETERS MAXIMUM SPACING AND WITH A MINIMUM OF TWO POSITIONERS PER GROUT POUR (ONE NEAR THE BOTTOM AND ONE NEAR THE TOP) TO PREVENT DISPLACEMENT DURING THE PLACEMENT OF GROUT. ALL REINFORCING BARS MUST 	 UNLESS NOTED OTHERWISE ON PLANS, UNDER LINTELS, BEARING PLATES, BEAMS, ETC.; FILL CELLS WITH GROUT, 3 COURSES MINIMUM BELOW BEARING. ALL REINFORCING STEEL SHALL BE SUPPORTED AND FASTENED TO APPROVED POSITIONERS LOCATED AT 192 BAR DIAMETERS MAXIMUM SPACING AND WITH A MINIMUM OF TWO POSITIONERS PER GROUT POUR (ONE NEAR THE BOTTOM AND ONE NEAR THE TOP) TO PREVENT DISPLACEMENT DURING THE PLACEMENT OF GROUT. ALL REINFORCING BARS MUST 	B. PROVIDE BUILDING PAPER BOND BREAK BELOW LINTEL BEARING ADJACENT TO	
LOCATED AT 192 BAR DIAMETERS MAXIMUM SPACING AND WITH A MINIMUM OF TWO POSITIONERS PER GROUT POUR (ONE NEAR THE BOTTOM AND ONE NEAR THE TOP) TO PREVENT DISPLACEMENT DURING THE PLACEMENT OF GROUT. ALL REINFORCING BARS MUST	LOCATED AT 192 BAR DIAMETERS MAXIMUM SPACING AND WITH A MINIMUM OF TWO POSITIONERS PER GROUT POUR (ONE NEAR THE BOTTOM AND ONE NEAR THE TOP) TO PREVENT DISPLACEMENT DURING THE PLACEMENT OF GROUT. ALL REINFORCING BARS MUST		
		LOCATED AT 192 BAR DIAMETERS MAXIMUM SPACING AND WITH A MINIMUM OF TWO POSITIONERS PER GROUT POUR (ONE NEAR THE BOTTOM AND ONE NEAR THE TOP) TO PREVENT DISPLACEMENT DURING THE PLACEMENT OF GROUT. ALL REINFORCING BARS MUST	

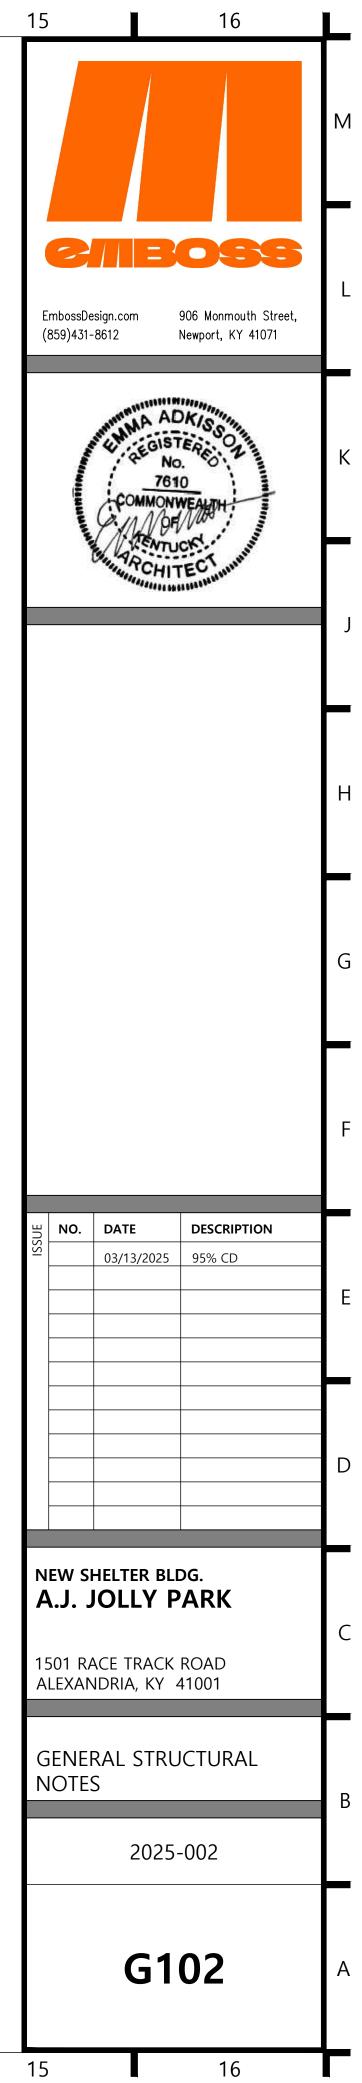


T

14

_12

13

12 13 14

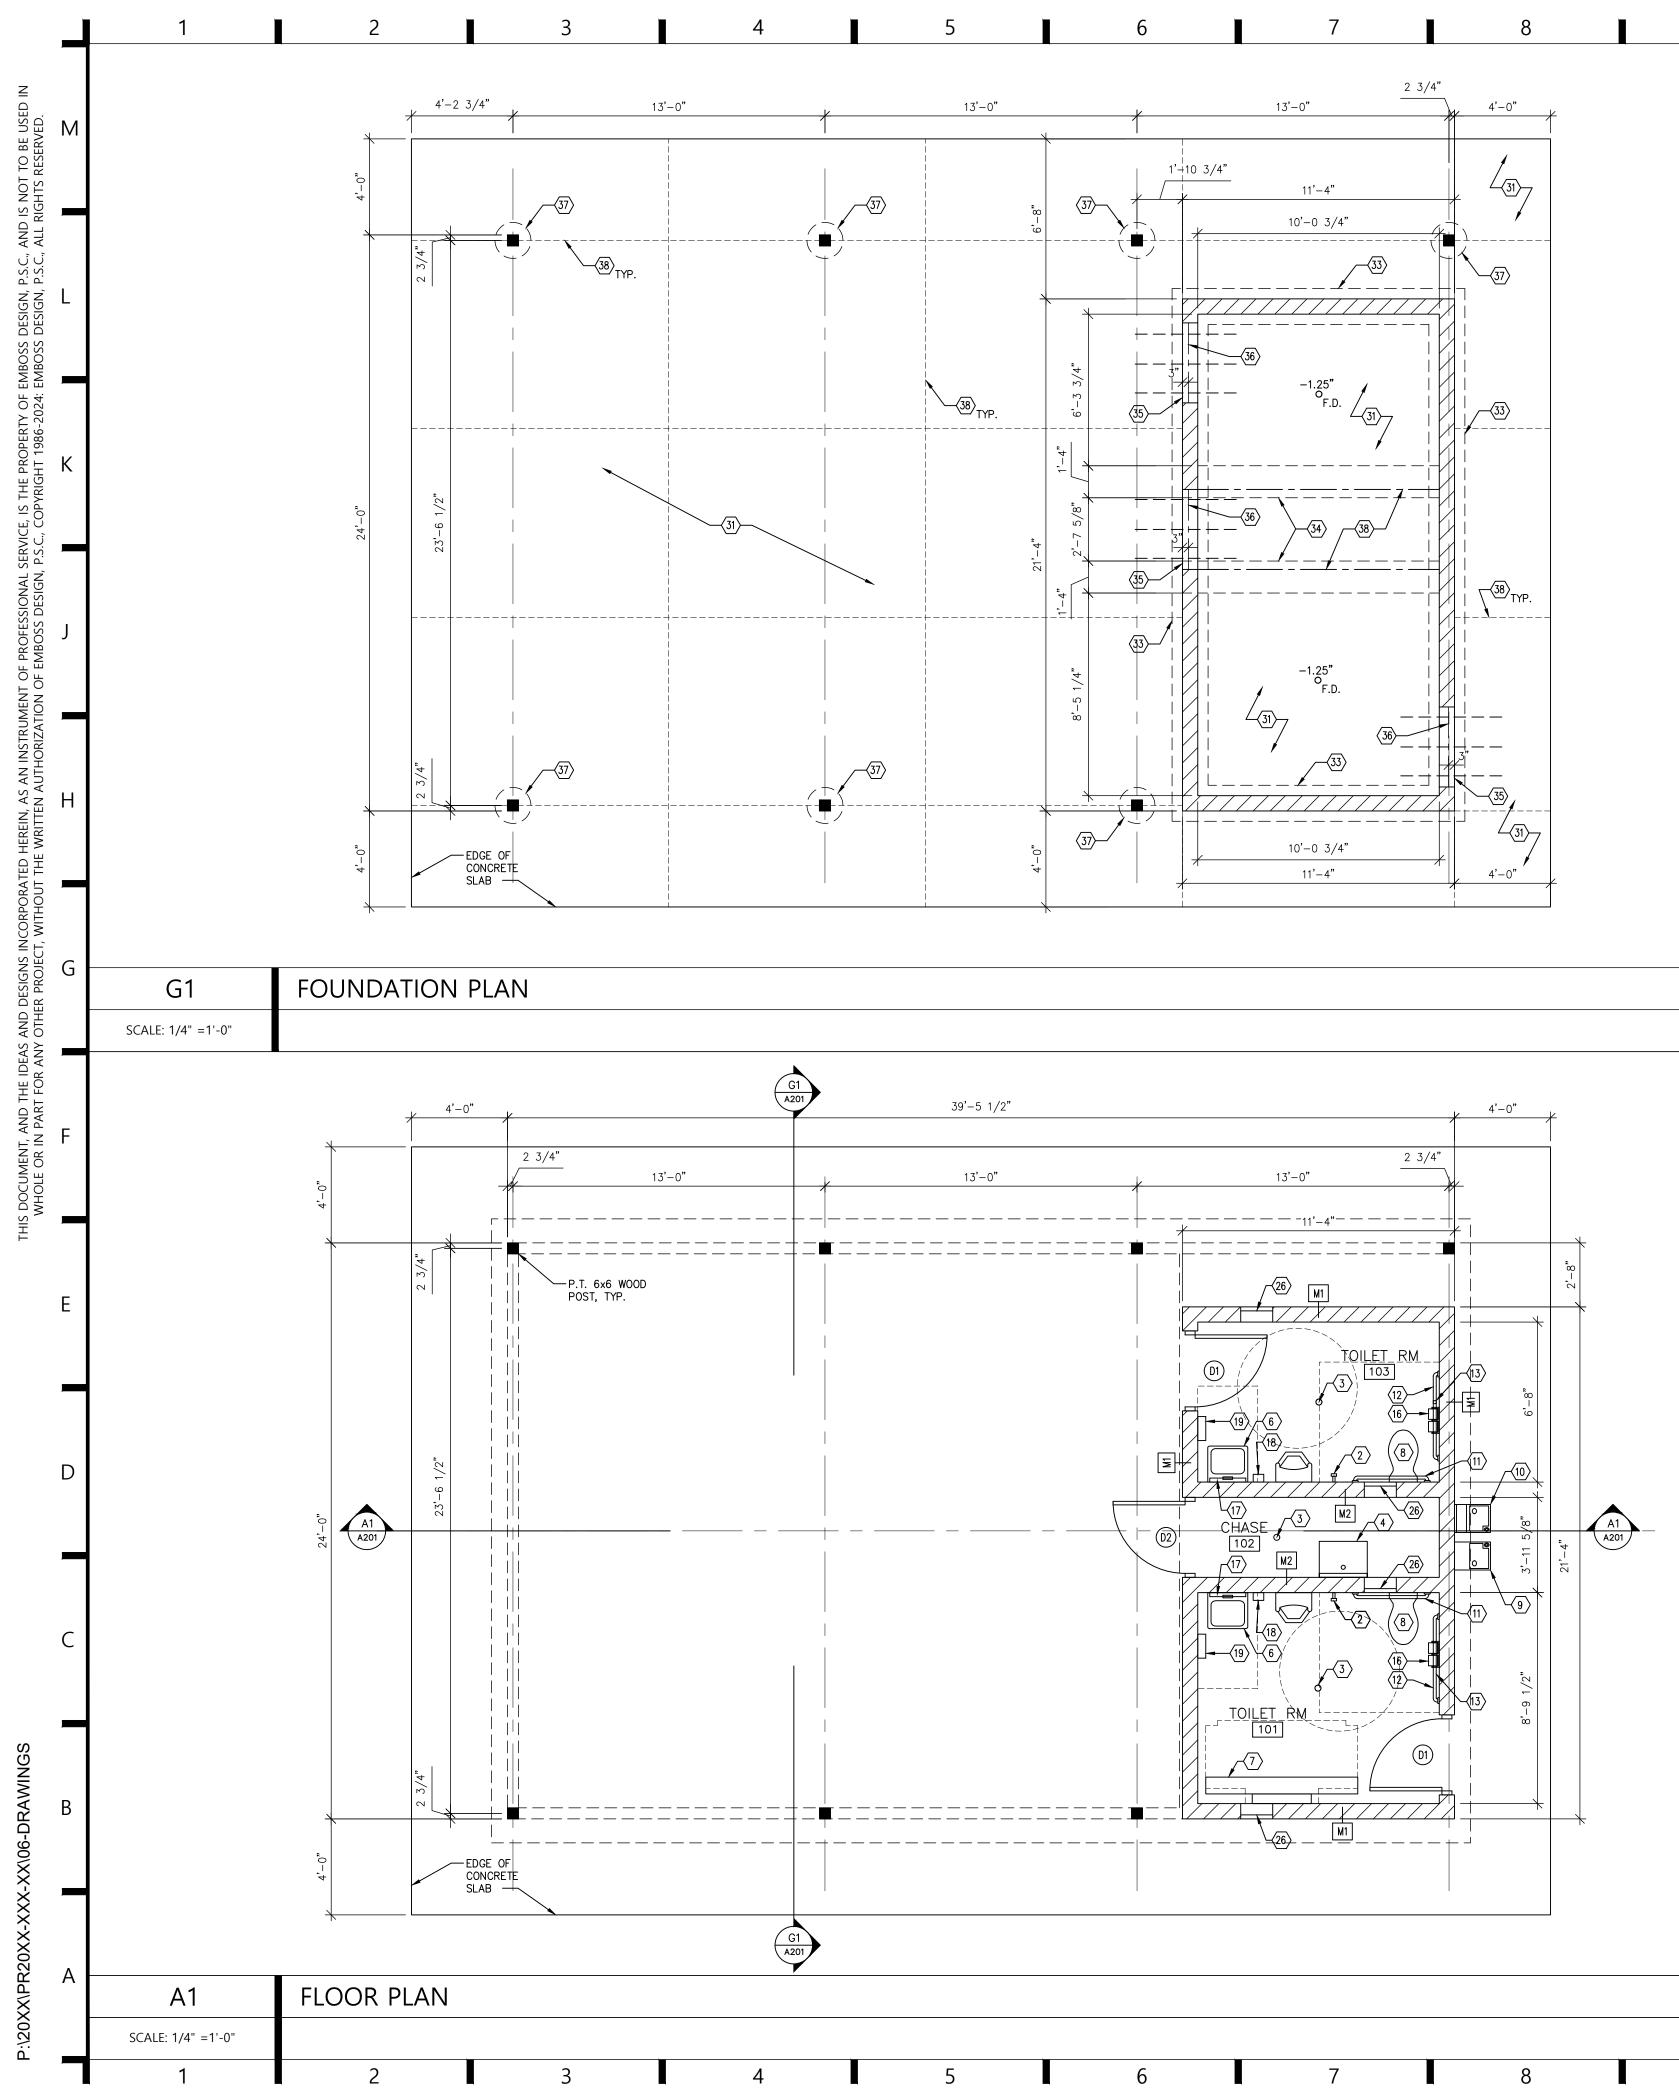



9



11

GENERAL NOTES

10

 EACH FIXTURE SHALL HAVE INDIVIDUAL SHUT-OFF VALVES.
 ALL SHUT-OFF VALVES SHALL BE LOCATED IN THE PIPE CHASE ROOM.
 PROVIDE CMU SOLID GROUTED BOND BEAM WITH (2) #5's OVER ALL DOOR OPENINGS.

WALL TYPES

M1 - EXTERIOR WALL PAINTED 8" SPLIT-FACE, CONCRETE MASONRY UNITS WITH TRUSS-TYPE HORIZONTAL REINFORCING AT 16" O.C. BREAK HORIZONTAL REINFORCING AT MASONRY CONTROL JOINTS. REINFORCE WITH #5'S VERTICALLY AT 48" O.C. MAXIMUM AND GROUT CORES SOLID. PROVIDE CMU SOLID GROUTED BOND BEAM WITH (2) #5'S OVER ALL DOOR OPENINGS.

M2 - INTERIOR WALL 8" STANDARD CONCRETE MASONRY UNITS WITH TRUSS-TYPE HORIZONTAL REINFORCING AT 16" O.C. BREAK HORIZONTAL REINFORCING AT MASONRY CONTROL JOINTS. REINFORCE WITH #5'S VERTICALLY AT 48" O.C., MAXIMUM, AND GROUT CORES SOLID.

ROOM FINISHES

FLOOR: STAINED AND SEALED CONCRETE.

WALLS: BLOCK FILLER AND (2) COATS EPOXY PAINT, TYP. PIPE CHASE #102 TO REMAIN UNPAINTED. CEILING: FIBERGLASS REINFORCED PANELS (FRP) – CLASS "C" MINIMUM" OVER 1/2" EXTERIOR GRADE WOOD SHEATHING

DOOR TYPES

ALL DOORS TO BE 3'-0"x7'-0"x1-3/4" GALVANIZED & PAINTED 16 GA. HOLLOW METAL. FRAMES TO BE GALV. & PAINTED 16 GA. HOLLOW METAL (GROUTED SOLID) WITH 4" HEAD. COLOR AS SELECTED BY OWNER.

DOOR TYPE 'D1' PROVIDE HINGES WITH NON-REMOVABLE PINS, LEVER HANDLED PRIVACY MORTISE LOCKSET WITH DEADBOLT AND OCCUPIED/UNOCCUPIED INDICATOR, CLOSER, THRESHOLD, WEATHER STRIPPING, INTERIOR & EXTERIOR KICKPLATES, AND WALL STOP.

DOOR TYPE 'D2' PROVIDE HINGES WITH NON-REMOVABLE PINS, LEVER HANDLED STORAGE ROOM MORTISE LOCKSET WITH DEADBOLT AND OCCUPIED/UNOCCUPIED INDICATOR, CLOSER, THRESHOLD, WEATHER STRIPPING, INTERIOR & EXTERIOR KICKPLATES, AND WALL STOP.

9

10

11

12

13

14


12	13	14


CONSTRUCTION KEYNOTES $\langle X \rangle$

- . NOT USED. 2. RECESSED WALL HYDRANT WITH KEY. . FLOOR DRAIN (SLOPE FLOOR TO DRAIN).
- FLOOR DRAIN (SLOPE FLOOR TO DRAIN).
 JANITOR SINK.
 NEW ELECTRICAL OUTLET, TYP.
 ADA COMPLIANT WALL MOUNTED LAVATORY. INSULATE SUPPLY AND SANITARY PIPING. VERIFY TYPE WITH THE OWNER.
 ADJUSTABLE UNIVERSAL CHANGING STATION. BASIS OF DESIGN: MAX-ABILITY PRESSALIT 3000 ADJUSTABLE ADULT CHANGING TABLE
 ADA COMPLIANT WALL MOUNTED TOILET WITH FLUSH VALVE. VERIFY TYPE WITH THE OWNER.
 STANDARD WATER FOUNTAIN.
 ADA WATER FOUNTAIN WITH BOTTLE FILLER.
 36" GRAB BAR.

- 12. 42" GRAB BAR.
- 13. 18" VERTICAL GRAB BAR.
- 14. 4' LONG MOISTURE RESISTANT, SURFACE MOUNTED LED LIGHT FIXTURE WITH MOTION ACTIVATED OCCUPANCY SENSOR, TYPICAL
- EXHAUST FAN/LIGHT TIED TO OCCUPANCY SENSOR, TYP (EXHAUST TO EXTERIOR)
 SURFACE MOUNTED MULTI-ROLL TOILET PAPER DISPENSER PROVIDED AND INSTALLED BY OWNER.
 24"x36" STAINLESS STEEL FRAMED MIRROR CENTERED OVER SINK.
- 24"x36" STAINLESS STEEL FRAMED MIRROR CENTERED OVER SINK.
 SURFACE MOUNTED SOAP DISPENSER, BOBRICK NO. B-2111, OR APPROVED EQUAL, PROVIDED AND INSTALLED BY OWNER.
 ADA COMPLIANT ELECTRIC HAND DRYER.
 FIBERGLASS REINFORCED PANELS INSTALLED OVER 1/2" PLYWOOD SHEATHING. PROVIDE TRIM ACCESSORIES AND ADHESIVE PER MANUFACTURER FOR A COMPLETE INSTALLATION
 NEW PRE-FINISHED VENTED ALUMINUM SOFFIT PANEL.
 80 WATT LED WALL PACK ON PHOTOCELL.
 CANOPY LIGHTS AT UNDERSIDE OF TRUSSES. COORDINATE TYPE AND LOCATION WITH OWNER.
 14 YG TONGUE & GROOVE, V-GROOVE CEILING PLANKS, STAINED

- ELECTRIC PANEL.
 MASONRY VENT SUNVENT INDUSTRIES MODEL NO. 157 OR APPROVED EQUAL. TOP OF VENT AT BOTTOM OF BOND BEAM. PROVIDE LOUVER COVER AT INTERIOR SIDE (RESTROOM SIDE) OF WALL. 27. NOT USED. 28. NOT USED. 29. NOT USED.
- 50. NOT USED.
- 30. NOT USED.
 31. 4" STAINED AND SEALED CONCRETE SLAB OVER COMPACTED 4" GRANULAR BASE (4,000 PSI AIR-ENTRAINED CONCRETE W/ TROWELED FINISH), TYPICAL. VERIFY STAIN COLOR W/ OWNER
- 32. NOT USED. 32. NOT USED. 33. 1'-6" WIDE X 2'-0" DEEP CONCRETE FOOTING. REINFORCE WITH (2) #5's CONTINUOUS TOP & BOTTOM. 34. 1'-4" WIDE X 1'-0" DEEP TRENCH DUG CONCRETE FOOTING. REINFORCE WITH (2) #5's CONTINUOUS. 35. HOLD FOUNDATION DOWN 8" AND POUR SLAB THROUGH, TYPICAL. PROVIDE (3) #4 18x18 BENT BARS INTO INTERIOR SLAB AND EXTERIOR PAVING. 36. 1/2" EXPANSION JOINT MATERIAL WITH SEALANT, TYPICAL.
- 37. 18" DIAMETER CONCRETE PIER CENTERED ON POST. REINFORCE WITH (4) #5s VERTICAL, (3) HORIZONTAL TIES, TOP, BOTTOM, & MIDDLE. 38. SAWCUT CONTROL JOINT IN CONCRETE SLAB (DEPTH EQUAL TO 1/4 OF SLAB THICKNESS), TYPICAL.

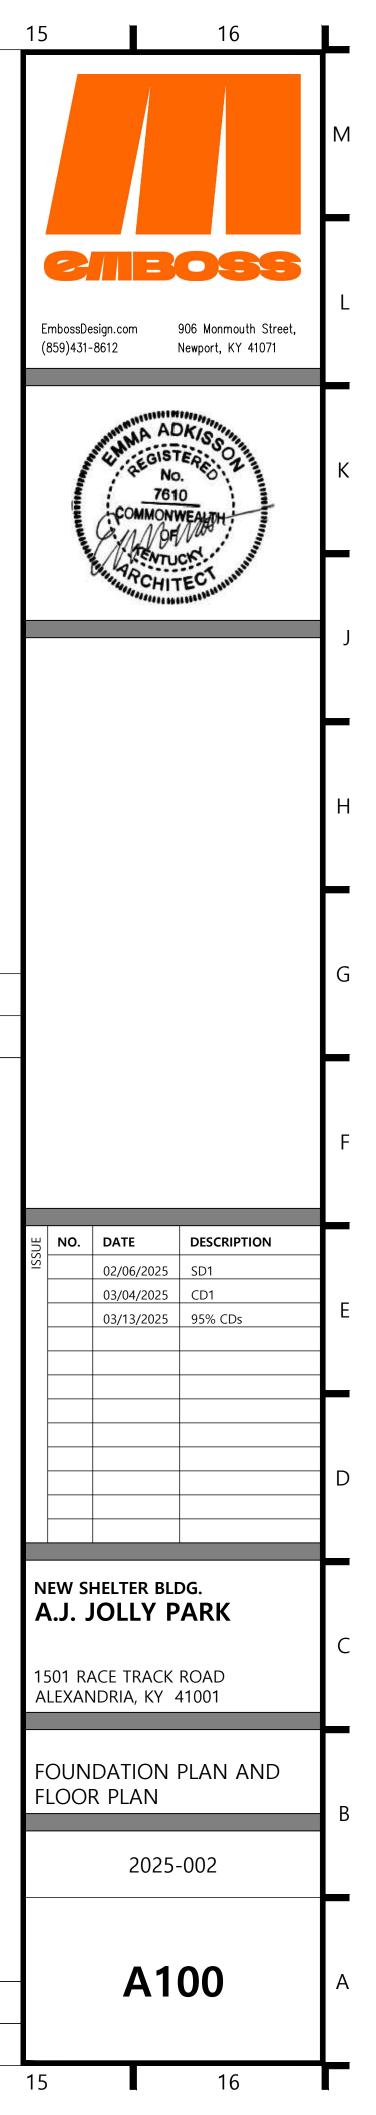

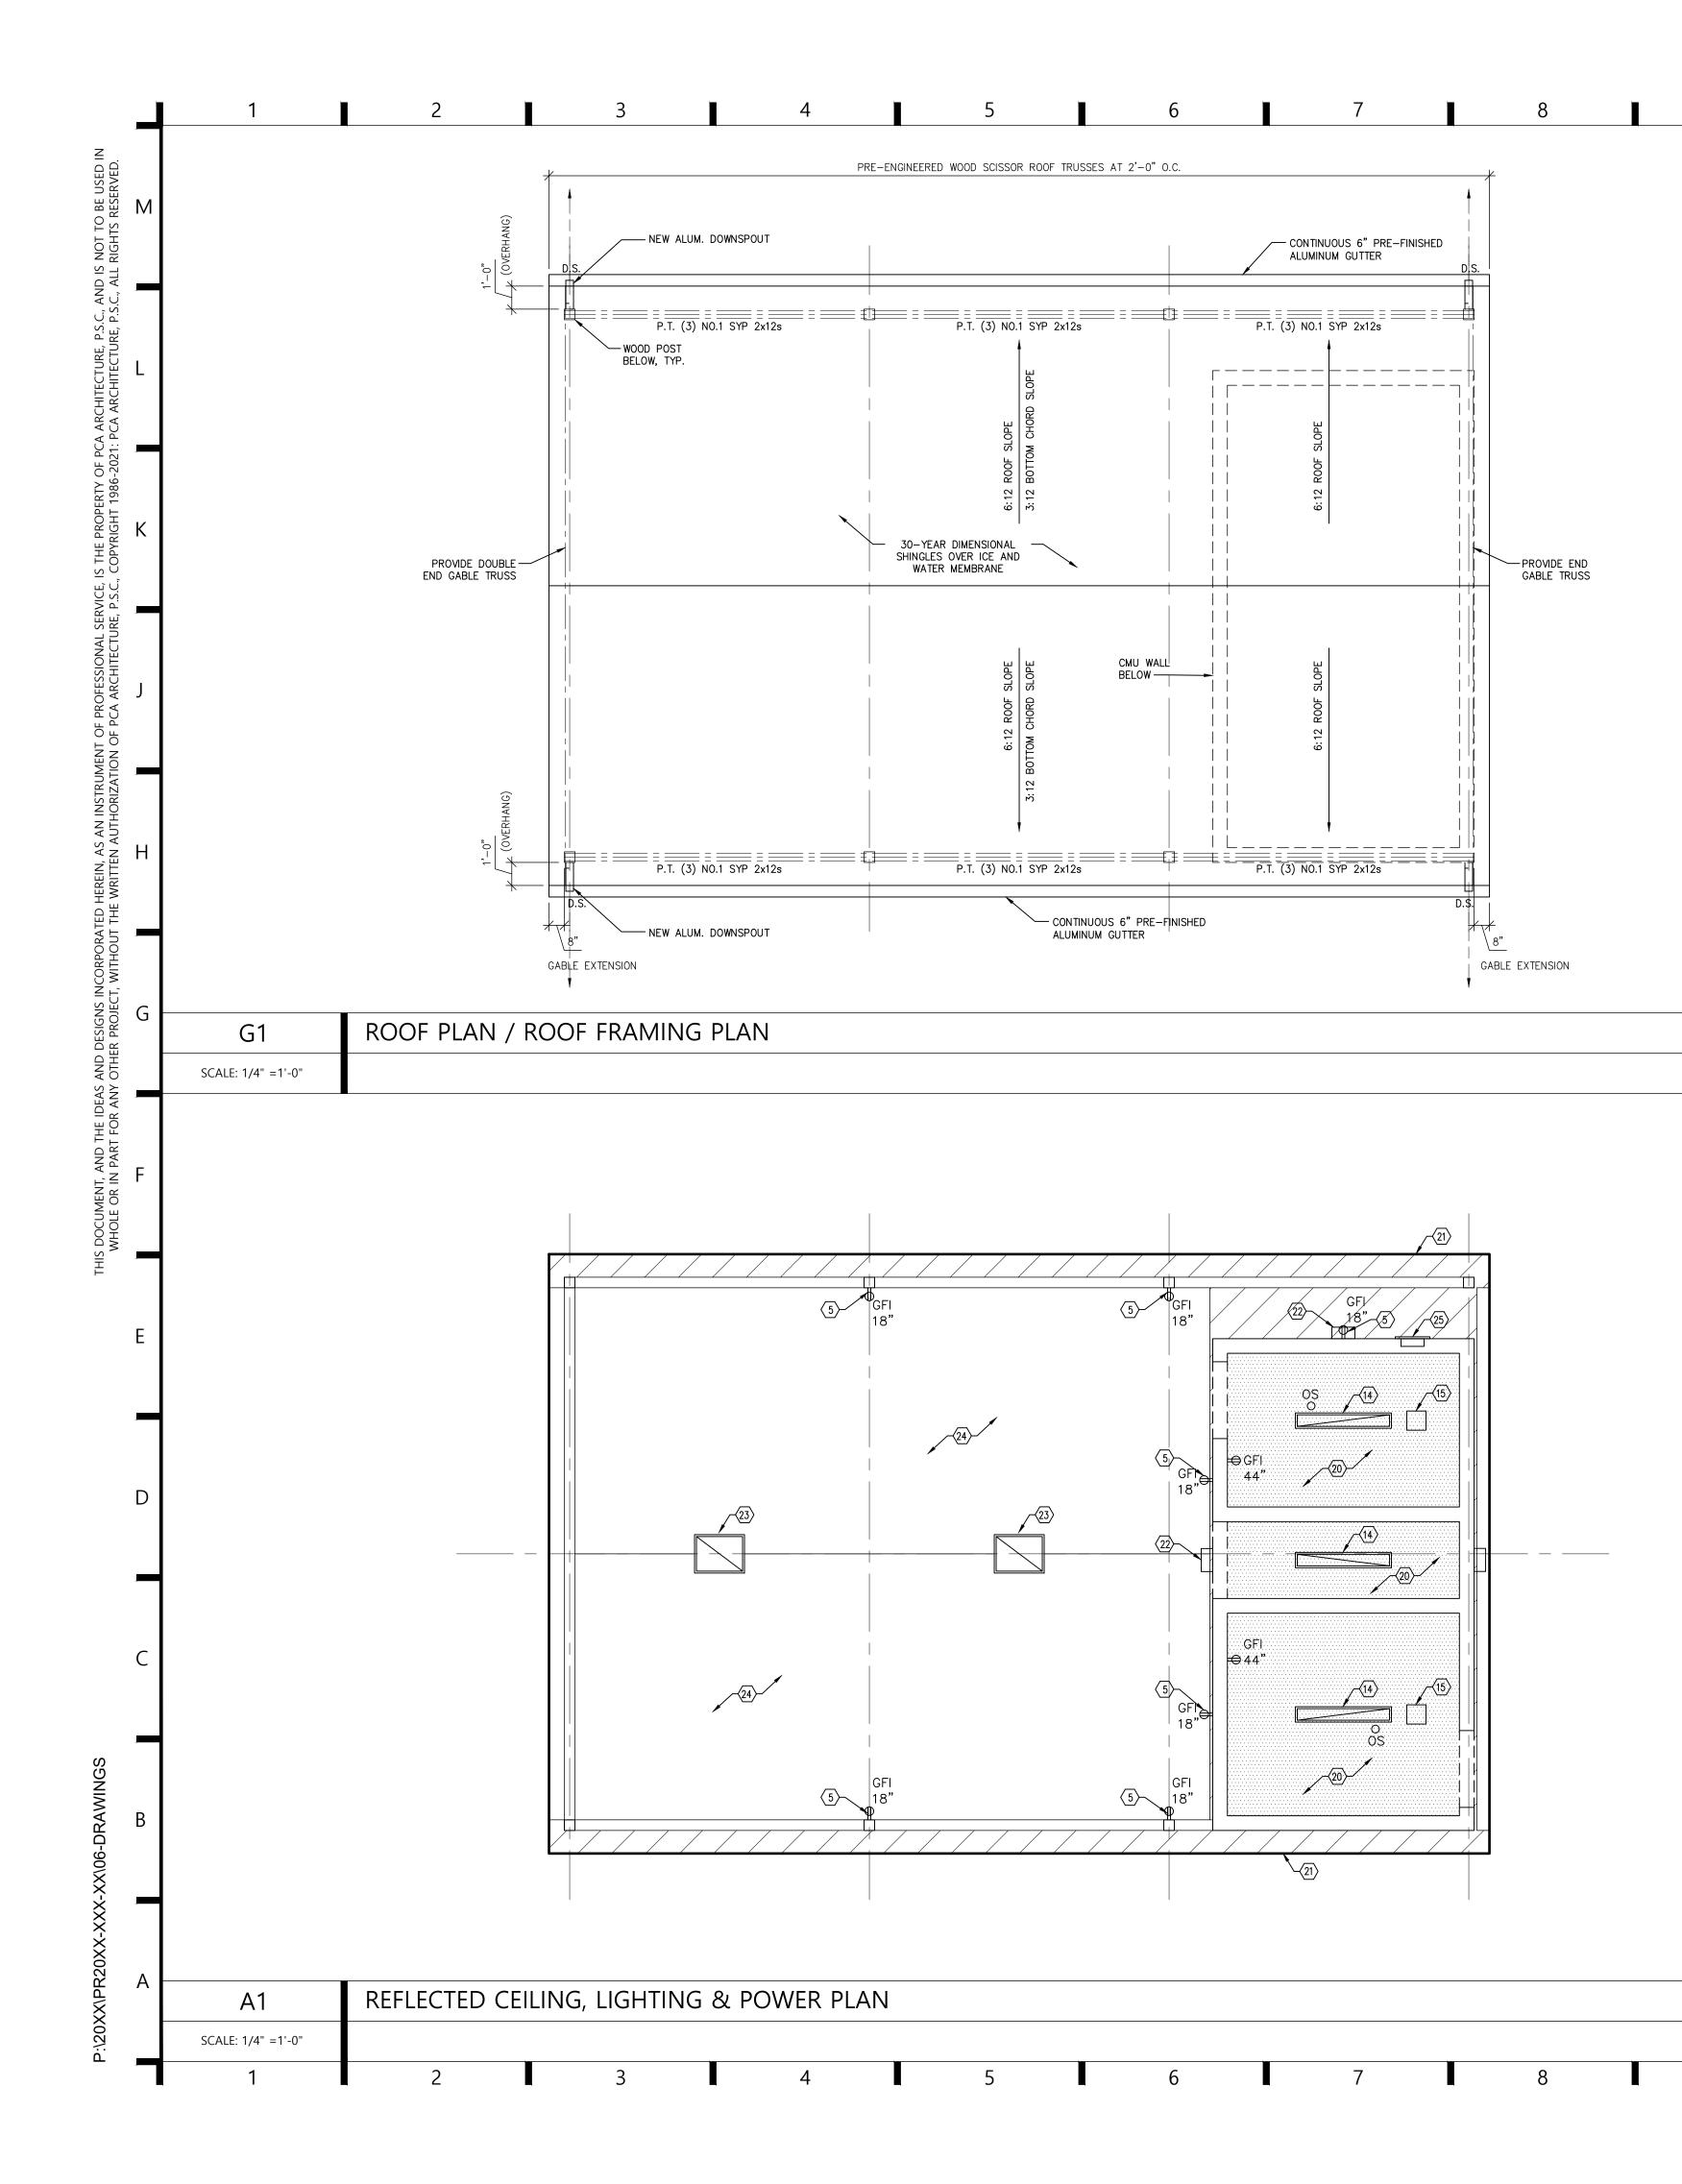

10	11

GENERAL NOTES

9

1. GUTTER TO BE CONTINUOUS 6" PRE-FINISHED ALUMINUM W/ SUPPORT BRACKETS AT 24" O.C. 2. DOWNSPOUTS TO BE PRE-FINISHED ALUMINUM W/ SUPPORT BRACKETS AT 48" O.C. TIE-INTO UNDERGROUND 4" DIAMETER STORM DRAINAGE PIPING AND EXTEND TO DAYLIGHT. COORDINATE LOCATION WITH OWNER

10

11


12	13	14

CONSTRUCTION KEYNOTES $\langle X \rangle$


- . NOT USED. 2. RECESSED WALL HYDRANT WITH KEY. 5. FLOOR DRAIN (SLOPE FLOOR TO DRAIN).
- FLOOR DRAIN (SLOPE FLOOR TO DRAIN).
 JANITOR SINK.
 JANITOR SINK.
 NEW ELECTRICAL OUTLET, TYP.
 ADA COMPLIANT WALL MOUNTED LAVATORY. INSULATE SUPPLY AND SANITARY PIPING. VERIFY TYPE WITH THE OWNER.
 ADJUSTABLE UNIVERSAL CHANGING STATION. BASIS OF DESIGN: MAX-ABILITY PRESSALIT 3000 ADJUSTABLE ADULT CHANGING TABLE
 ADA COMPLIANT WALL MOUNTED TOILET WITH FLUSH VALVE. VERIFY TYPE WITH THE OWNER.
 STANDARD WATER FOUNTAIN.
 ADA WATER FOUNTAIN WITH BOTTLE FILLER.
 36" GRAB BAR.
 42" GRAB BAR.

- 12. 42" GRAB BAR.
- 13. 18" VERTICAL GRAB BAR.
- 14. 4' LONG MOISTURE RESISTANT, SURFACE MOUNTED LED LIGHT FIXTURE WITH MOTION ACTIVATED OCCUPANCY SENSOR, TYPICAL

- SENSOR, TYPICAL
 15. EXHAUST FAN/LIGHT TIED TO OCCUPANCY SENSOR, TYP (EXHAUST TO EXTERIOR)
 16. SURFACE MOUNTED MULTI-ROLL TOILET PAPER DISPENSER PROVIDED AND INSTALLED BY OWNER.
 17. 24"x36" STAINLESS STEEL FRAMED MIRROR CENTERED OVER SINK.
 18. SURFACE MOUNTED SOAP DISPENSER, BOBRICK NO. B-2111, OR APPROVED EQUAL, PROVIDED AND INSTALLED BY OWNER.
 19. ADA COMPLIANT ELECTRIC HAND DRYER.
 20. FIBERGLASS REINFORCED PANELS INSTALLED OVER 1/2" PLYWOOD SHEATHING. PROVIDE TRIM ACCESSORIES AND ADHESIVE PER MANUFACTURER FOR A COMPLETE INSTALLATION
 21. NEW PRE-FINISHED VENTED ALUMINUM SOFFIT PANEL.
 22. 80 WATT LED WALL PACK ON PHOTOCELL.
 23. CANOPY LIGHTS AT UNDERSIDE OF TRUSSES. COORDINATE TYPE AND LOCATION WITH OWNER.
 24. 1X6 TONGUE & GROOVE, V-GROOVE CEILING PLANKS, STAINED
 25. ELECTRIC PANEL.
- ELECTRIC PANEL.
 MASONRY VENT SUNVENT INDUSTRIES MODEL NO. 157 OR APPROVED EQUAL. TOP OF VENT AT BOTTOM OF BOND BEAM. PROVIDE LOUVER COVER AT INTERIOR SIDE (RESTROOM SIDE) OF WALL.
- 27. NOT USED. 28. NOT USED. 29. NOT USED.
- 29. NOT USED.
 30. NOT USED.
 31. 4" STAINED AND SEALED CONCRETE SLAB OVER COMPACTED 4" GRANULAR BASE (4,000 PSI AIR-ENTRAINED CONCRETE W/ TROWELED FINISH), TYPICAL. VERIFY STAIN COLOR W/ OWNER
- 32. NOT USED. 33. 1'-6" WIDE X 2'-0" DEEP CONCRETE FOOTING. REINFORCE WITH (2) #5's CONTINUOUS TOP & BOTTOM. 34. 1'-4" WIDE X 1'-0" DEEP TRENCH DUG CONCRETE FOOTING. REINFORCE WITH (2) #5's CONTINUOUS. 35. HOLD FOUNDATION DOWN 8" AND POUR SLAB THROUGH, TYPICAL. PROVIDE (3) #4 18x18 BENT BARS
- 35. HOLD FOUNDATION DOWN & AND FOUN SEAS THROUGH, THROUGH HORIZONTAL TIES, TOP, BOTTOM, & MIDDLE. 38. SAWCUT CONTROL JOINT IN CONCRETE SLAB (DEPTH EQUAL TO 1/4 OF SLAB THICKNESS), TYPICAL.

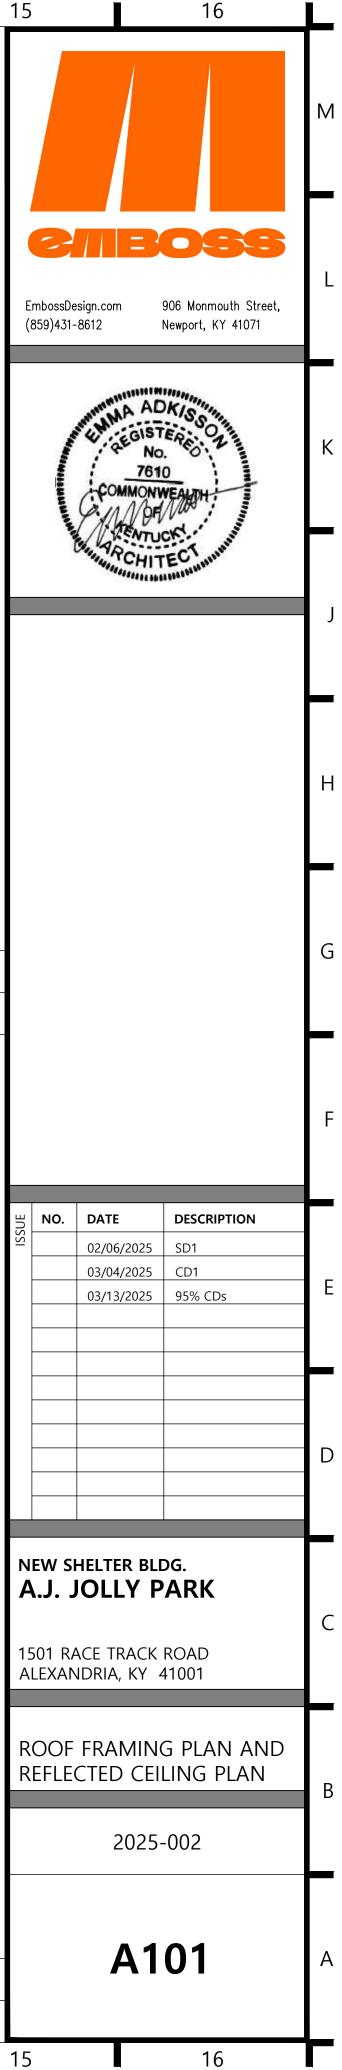

12 13

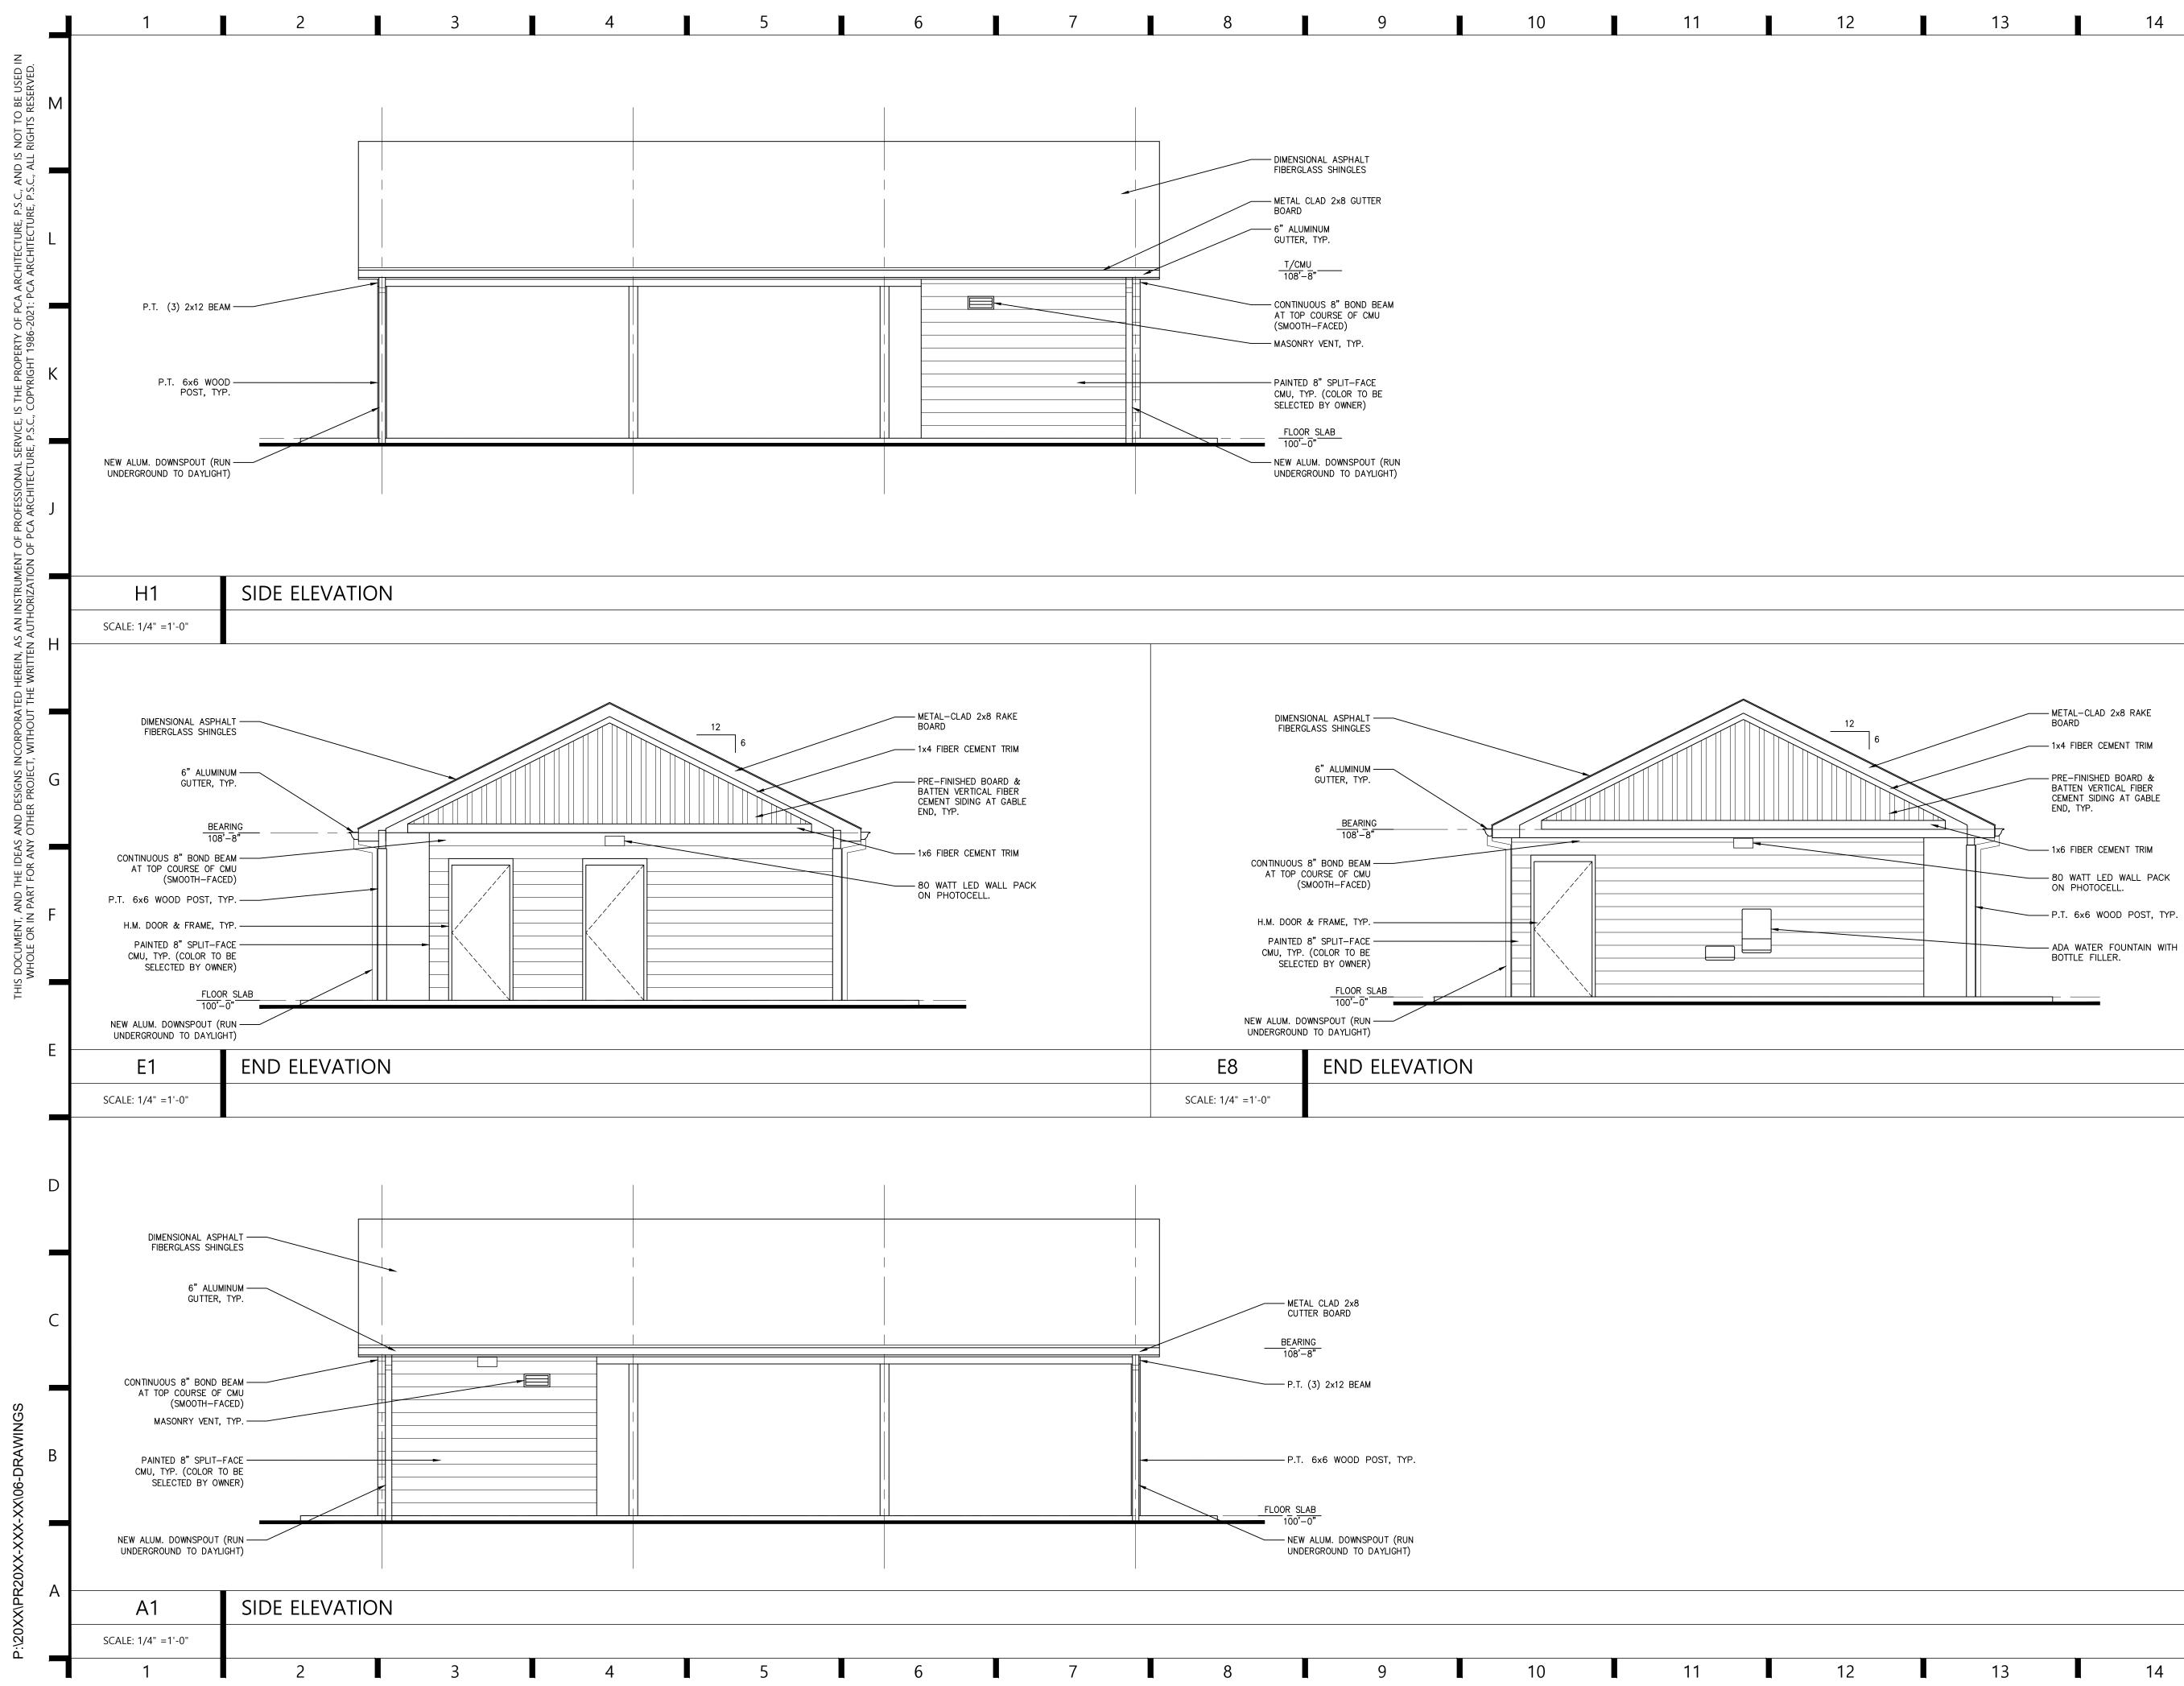

6	7	8	9	10	11	

